

CONTENTS:

1. A Simplified but Accurate Prevision Method for A Stand-Alone Photovoltaic Pumping System using Linear Interpolation/Extrapolation <i>Mohammed Yaichi, Abdelkrim Mammari, Sid-Ali Chikhi, and Mohammed-Karim Fellah</i> -----	461
2. Prototype Design and Analysis of Miniature Pulse Discharge Current Generator on Various Burdens <i>Waluyo, Syahrial, Sigit Nugraha, and Yudhi Permana JR</i> ----	472
3. Performance Evaluation of DFIG During Asymmetrical Grid Disturbances Using Internal Model Controller and Resonant Controller <i>D.V.N. Ananth and G.V. Nagesh Kumar</i> -----	494
4. A New Learning and Fuzzy Strategy for Active Power Filtering <i>Hichem Laib, Abd Elaziz Chaghi and Patrice Wira</i> -----	518
5. Multi Objective Generation Dispatch of a Hybrid System with Fuzzy based Space Search Algorithm <i>Prakash Kumar Hota, Nakul Charan Sahu and Ajit Kumar Barisal</i> -----	528
6. Reconstruction of Holographic Microscopy Images Based on Matching Pursuits on A Pair of Domains <i>Andriyan Bayu Suksmono and Akira Hirose</i> -----	553
7. Optimal Location for Fixing Fuel Cells in a Distributed Generation Environment using Hybrid Technique <i>T.C.Subramanyam, S.S.Tulasi Ram, and JBV Subrahmanyam</i> -----	567
8. Toward CMOS Process-Compatible Gold Nanoparticles Deposition with Pattern for Electronics Application <i>Irman Idris, Muhammad Amin S., Gilang Mardian K, and Akhmadi Surawijaya</i> -----	588
9. An Inclusive Review on Load Frequency Control in Deregulated Market <i>Shital M. Pujara and Chetan D. Kotwal</i> -----	595
10. An Efficient Video Watermark Method with Adaptive Use of Block QP <i>DongHwan Shin and JungUk Choi</i> -----	612
11. EMF Estimation of Over Head Transmission Line Using CS Algorithm with Aid of NFC <i>P. Sivakami and P. Subburaj</i> -----	625
12. State Elimination in Accelerated Multiagent Reinforcement Learning <i>Ary Setijadi Prihatmanto, Widyawardana Adiprawita, Safreni Candra Sari, and Kuspriyanto</i> -----	646
13. Assessment of Partial Discharge Signatures in Transformer Oil Insulation using Hidden Markov Model <i>M. Balasubramanian and S. Venkatesh</i> -----	661
14. Particle Filter-based Multitarget Multicamera Tracking System utilizing Random Finite Sets and Distributed Estimation Process <i>Lenni Yulianti, Bambang Riyanto Trilaksana, Ary Setijadi Prihatmanto, and Widyawardana Adiprawita</i> -----	676

# International Journal on Electrical Engineering and Informatics



Published by :



School of Electrical Engineering and Informatics  
Institut Teknologi Bandung  
INDONESIA



Volume 8, Number 3, September 2016

ISSN 2085-6830  
e-ISSN 2087-5886

# International Journal on Electrical Engineering and Informatics



Published by :



School of Electrical Engineering and Informatics  
Institut Teknologi Bandung  
INDONESIA

International Journal on Electrical Engineering and Informatics is a peer reviewed journal in the field of electrical engineering and informatics. The journal is published quarterly by The School of Electrical Engineering and Informatics, Institut Teknologi Bandung, Indonesia. All papers will be blind reviewed.

**Scope:**

The journal publishes original papers in the field of electrical engineering and informatics which covers the following scope:

- **Power Engineering**  
Electric Power Generation, Transmission and Distribution, Power Electronics, Power Quality, Power Economic, FACTS, Renewable Energy, Electric Traction, Electromagnetic Compatibility, Electrical Engineering Materials, High Voltage Insulation Technologies, High Voltage Apparatuses, Lightning Detection and Protection, Power System Analysis, SCADA, Electrical Measurements.
- **Telecommunication Engineering**  
Antenna and Wave Propagation, Modulation and Signal Processing for Telecommunication, Wireless and Mobile Communications, Information Theory and Coding, Communication Electronics and Microwave, Radar Imaging, Distributed Platform, Communication Network and Systems, Telematics Services, Security Network, and Radio Communication.
- **Computer Engineering**  
Computer Architecture, Parallel and Distributed Computer, Pervasive Computing, Computer Network, Embedded System, Human—Computer Interaction, Virtual/Augmented Reality, Computer Security, VLSI Design-Network Traffic Modeling, Performance Modeling, Dependable Computing, High Performance Computing, Computer Security.
- **Control and Computer Systems**  
Optimal, Robust and Adaptive Controls, Non Linear and Stochastic Controls, Modeling and Identification, Robotics, Image Based Control, Hybrid and Switching Control, Process Optimization and Scheduling, Control and Intelligent Systems, Artificial Intelligent and Expert System, Fuzzy Logic and Neural Network, Complex Adaptive Systems.
- **Electronics**  
To Study Microelectronic System, Electronic Materials, Design and Implementation of Application Specific Integrated Circuits (ASIC), System-on-a-Chip (SoC) and Electronic Instrumentation Using CAD Tools.
- **Information Technology**  
Digital Signal Processing, Human-Machine Interface, Stochastic Systems, Information Theory, Intelligent Systems, IT Governance, Networking Technology, Optical Communication Technology, Next Generation Media, Robotic Instrumentation.
- **Informatics**  
Information Search Engine, Multimedia Security, Computer Vision, Information Retrieval, Intelligent System, Distributed Computing System, Mobile Processing, Next Network Generation, Computer Network Security, Natural Language Processing, Business Process, Cognitive Systems.
- **Data and Software Engineering**  
Software Engineering (Software: Lifecycle, Management, Engineering Process, Engineering Tools and Methods), Programming (Programming Methodology and Paradigm), Data Engineering (Data and Knowledge Level Modeling, Information Management (DB) Practices, Knowledge Based Management System, Knowledge Discovery in Data).
- **Biomedical Engineering**  
Biomedical Physics, Biomedical Transducers and Instrumentation, Biomedical System Design and Projects, Medical Imaging Equipment and Techniques, Telemedicine System, Biomedical Imaging and Image Processing, Biomedical Informatics and Telemedicine, Biomechanics and Rehabilitation Engineering, Biomaterials and Drug Delivery Systems.

Indeks Bias  
Hukum Snellius  
Sudut Kritis  
Apertur Numerik

Pengertian pemrograman berorientasi objek.  
Interfacing (RS-232, 485, USB, dll)



# International Journal on Electrical Engineering and Informatics

**Printed ISSN 2085-6830/ online e-ISSN 2087-5886**

Indexed by:

- Scopus (SJR 2015 = 0.219)
- Index Copernicus (ICV 2013 = 6.33)
- Scholar Google
- DOAJ
- EBSCO
- ProQuest

## **Aims & Scope**

International Journal on Electrical Engineering and Informatics is a peer reviewed journal in the field of electrical engineering and informatics. The journal is published quarterly by The School of Electrical Engineering and Informatics, Institut Teknologi Bandung, Indonesia. All papers will be blind reviewed. Accepted papers will be available on line (free access) and printed version. No publication fee.

The journal publishes original papers in the field of electrical engineering and informatics which covers, but not limited to, the following scope :

### **Power Engineering**

Electric Power Generation, Transmission and Distribution, Power Electronics, Power Quality, Power Economic, FACTS, Renewable Energy, Electric Traction, Electromagnetic Compatibility, Electrical Engineering Materials, High Voltage Insulation Technologies, High Voltage Apparatuses, Lightning Detection and Protection, Power System Analysis, SCADA, Electrical Measurements

### **Telecommunication Engineering**

Antenna and Wave Propagation, Modulation and Signal Processing for Telecommunication, Wireless and Mobile Communications, Information Theory and Coding, Communication Electronics and Microwave, Radar Imaging, Distributed Platform, Communication Network and Systems, Telematics Services, Security Network, and Radio Communication.

### **Computer Engineering**

Computer Architecture, Parallel and Distributed Computer, Pervasive Computing, Computer Network, Embedded System, Human—Computer Interaction, Virtual/Augmented Reality, Computer Security, VLSI Design-Network Traffic Modeling, Performance Modeling, Dependable Computing, High Performance Computing, Computer Security

### **Control and Computer Systems**

Optimal, Robust and Adaptive Controls, Non Linear and Stochastic Controls, Modeling and Identification, Robotics, Image Based Control, Hybrid and Switching Control, Process Optimization and Scheduling, Control and Intelligent Systems, Artificial Intelligent and Expert System, Fuzzy Logic and Neural Network, Complex Adaptive Systems.

### **Electronics**

To Study Microelectronic System, Electronic Materials, Design and Implementation of Application Specific Integrated Circuits (ASIC), System-on-a-Chip (SoC) and Electronic Instrumentation Using CAD Tools

### **Information technology**

Digital Signal Processing, Human-Machine Interface, Stochastic Systems, Information Theory, Intelligent Systems, IT Governance, Networking Technology, Optical Communication Technology, Next Generation Media, Robotic Instrumentation

### **Informatics**

Information Search Engine, Multimedia Security, Computer Vision, Information Retrieval, Intelligent System, Distributed Computing System, Mobile Processing, Next Network Generation, Computer Network Security, Natural Language Processing, Business Process, Cognitive Systems.

### **Data and Software engineering**

Software Engineering (Software: Lifecycle, Management, Engineering Process, Engineering Tools and Methods), Programming (Programming Methodology and Paradigm), Data Engineering (Data and Knowledge level Modeling, Information Management (DB) practices, Knowledge Based Management System, Knowledge Discovery in Data)

### **Biomedical Engineering**

Biomedical Physics, Biomedical Transducers and instrumentation, Biomedical System Design and Projects, Medical Imaging Equipment and Techniques, Telemedicine System, Biomedical Imaging and Image Processing, Biomedical Informatics and Telemedicine, Biomechanics and Rehabilitation Engineering, Biomaterials and Drug Delivery Systems.

### **About IJEEI**

- [Aims & Scope](#)
- [Editorial Board](#)
- [Current Papers](#)
- [Contact IJEEI](#)
- [Archives](#)
- [Manuscript Preparation](#)
- [Policies](#)
- [Submission](#)

## Search

### Visitors since January 2010

227008

### Today's visitors

204





# International Journal on Electrical Engineering and Informatics

**Printed ISSN 2085-6830/ online e-ISSN 2087-5886**

Indexed by:

- Scopus (SJR 2015 = 0.219)
- Index Copernicus (ICV 2013 = 6.33)
- Scholar Google
- DOAJ
- EBSCO
- ProQuest

## **Peer Review Process:**


After the article passes the plagiarism checking stage, each manuscript will be reviewed by at least two independent referees who are within the subject area. All review process are in English Language

## **Open Access Policy:**

This journal provides immediate open access to its content on the principle that making research freely available to the public supports a greater global exchange of knowledge.

## **View My Stats:**

This work is licensed under a [Creative Commons Attribution-NoDerivatives 4.0 International License](https://creativecommons.org/licenses/by-nd/4.0/).

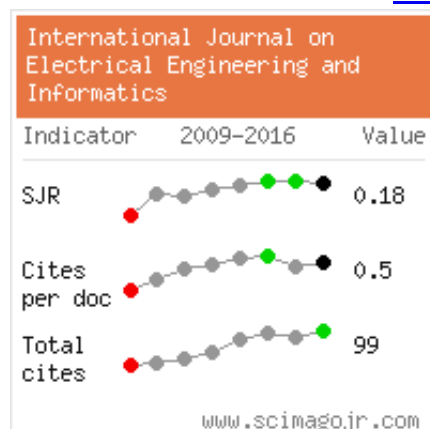

## **About IJEEI**

- [Aims & Scope](#)
- [Editorial Board](#)
- [Current Papers](#)
- [Contact IJEEI](#)
- [Archives](#)
- [Manuscript Preparation](#)
- [Policies](#)
- [Submission](#)

## Search



## Visitors since January 2010











227009

## Today's visitors

205



## Visitors

 IN 13,246	 MA 1,380
 ID 5,228	 TN 1,216
 DZ 4,045	 EG 747
 US 2,721	 MY 701
 IR 2,107	 IQ 387





CONTENTS:

1. A Simplified but Accurate Prevision Method for A Stand-Alone Photovoltaic Pumping System using Linear Interpolation/Extrapolation <i>Mohammed Yaichi, Abdelkrim Mammeri, Sid-Ali Chikhi, and Mohammed-Karim Fellah</i> -----	461
2. Prototype Design and Analysis of Miniature Pulse Discharge Current Generator on Various Burdens <i>Waluyo, Syahrial, Sigit Nugraha, and Yudhi Permana JR</i> -----	472
3. Performance Evaluation of DFIG During Asymmetrical Grid Disturbances Using Internal Model Controller and Resonant Controller <i>D.V.N. Ananth and G.V. Nagesh Kumar</i> -----	494
4. A New Learning and Fuzzy Strategy for Active Power Filtering <i>Hichem Laib, Abd Elaziz Chaghi and Patrice Wira</i> -----	518
5. Multi Objective Generation Dispatch of a Hybrid System with Fuzzy based Space Search Algorithm <i>Prakash Kumar Hota, Nakul Charan Sahu and Ajit Kumar Barisal</i> -----	528
6. Reconstruction of Holographic Microscopy Images Based on Matching Pursuits on A Pair of Domains <i>Andriyan Bayu Suksmo and Akira Hirose</i> -----	553
7. Optimal Location for Fixing Fuel Cells in a Distributed Generation Environment using Hybrid Technique <i>T.C.Subramanyam, S.S.Tulasi Ram, and JBV Subrahmanyam</i> -----	567
8. Toward CMOS Process-Compatible Gold Nanoparticles Deposition with Pattern for Electronics Application <i>Irman Idris, Muhammad Amin S., Gilang Mardian K., and Akhmadi Surawijaya</i> -----	588
9. An Inclusive Review on Load Frequency Control in Deregulated Market <i>Shital M. Pujara and Chetan D. Kotwal</i> -----	595
10. An Efficient Video Watermark Method with Adaptive Use of Block QP <i>DongHwan Shin and JungUk Choi</i> -----	612
11. EMF Estimation of Over Head Transmission Line Using CS Algorithm with Aid of NFC <i>P. Sivakami and P. Subburaj</i> -----	625
12. State Elimination in Accelerated Multiagent Reinforcement Learning <i>Ary Setijadi Prihatmanto, Widyawardana Adiprawita, Safreni Candra Sari, and Kuspriyanto</i> -----	646
13. Assessment of Partial Discharge Signatures in Transformer Oil Insulation using Hidden Markov Model <i>M. Balasubramanian and S. Venkatesh</i> -----	661
14. Particle Filter-based Multitarget Multicamera Tracking System utilizing Random Finite Sets and Distributed Estimation Process <i>Lenni Yulianti, Bambang Riyanto Trilaksono, Ary Setijadi Prihatmanto, and Widyawardana Adiprawita</i> -----	676
15. COA Based SSSC and STATCOM Optimal Controllers Designing with The Aim of Better Damping of Oscillations: A Comparative Study <i>Behrouz Mohammadzadeh, Reza Gholizadeh-Roshanagh, Sajad Najafi-Ravadanegh and Seyed Reza Seyed Nouri</i> -----	697

ISSN 2085-6830



9 772085 683034



## AIMS & SCOPE

International Journal on Electrical Engineering and Informatics is a peer reviewed journal in the field of electrical engineering and informatics. The journal is published quarterly by The School of Electrical Engineering and Informatics, Institut Teknologi Bandung, Indonesia. All papers will be blind reviewed. Accepted papers will be available on line (free access) and printed version.

The journal publishes original papers in the field of electrical engineering and informatics which covers the following scope:

### Power Engineering

Electric Power Generation, Transmission and Distribution, Power Electronics, Power Quality, Power Economic, FACTS, Renewable Energy, Smart Grid, Electric Traction, Electric Vehicles, Electromagnetic Compatibility, Electrical Engineering Materials(Conductors, Superconductors, Dielectrics and Magnetics), High Voltage Insulation Technologies, High Voltage Apparatuses, Lightning Detection and Protection, Power System Analysis, Power System Protection, SCADA, Electrical Measurements

### Telecommunication Engineering

Antenna and Wave Propagation, Modulation and Signal Processing for Telecommunication, Wireless and Mobile Communications, Information Theory and Coding, Communication Electronics and Microwave, Radar Imaging, Distributed Platform, Communication Network and Systems, Telematics Services, Security Network, and Radio Communication.

### Computer Engineering

Computer Architecture, Parallel and Distributed Computer, Pervasive Computing, Computer Network, Embedded System, Human-Computer Interaction, Virtual/Augmented Reality, Computer Security, VLSI Design-Network Traffic Modeling, Performance Modeling, Dependable Computing, High Performance Computing, Computer Security

### Control and Computer Systems

Optimal, Robust and Adaptive Controls, Non Linear and Stochastic Controls, Modeling and Identification, Robotics, Image Based Control, Hybrid and Switching Control, Process Optimization and Scheduling, Control and Intelligent Systems, Artificial Intelligent and Expert System, Fuzzy Logic and Neural Network, Complex Adaptive Systems.

### Electronics

To Study Microelectronic System, Electronic Materials (semiconductors and optics), Design and Implementation of Application Specific Integrated Circuits (ASIC), System-on-a-Chip (SoC) and Electronic Instrumentation Using CAD Tools, Sensors

### Information technology

Digital Signal Processing, Human-Machine Interface, Stochastic Systems, Information Theory, Intelligent Systems, IT Governance, Networking Technology, Optical Communication Technology, Next Generation Media, Robotic Instrumentation

### Informatics

Information Search Engine, Multimedia Security, Computer Vision, Information Retrieval, Intelligent System, Distributed Computing System, Mobile Processing, Next Network Generation, Computer Network Security, Natural Language Processing, Business Process, Cognitive Systems.

### Data and Software engineering


Software Engineering (Software: Lifecycle, Management, Engineering Process, Engineering Tools and Methods), Programming (Programming Methodology and Paradigm), Data Engineering (Data and Knowledge level Modeling, Information Management (DB) practices, Knowledge Based Management System, Knowledge Discovery in Data)

### Biomedical Engineering

## ABOUT IJEI

- [Aims & Scope](#)
- [Editorial Board](#)
- [Current Papers](#)
- [Contact IJEI](#)
- [Archives](#)
- [Manuscript Preparation](#)
- [Policies](#)
- [Submission](#)

## SEARCH



Visitors since January 2010  
439072

Today's visitors  
72



Country	Visitors
IN	76,642
ID	49,293
DZ	21,055
US	10,890
IR	8,090
MA	7,194
IQ	5,765
EG	4,930
MY	3,918
TN	2,861

Biomedical Physics, Biomedical Transducers and instrumentation, Biomedical System Design and Projects, Medical Imaging Equipment and Techniques, Telemedicine System, Biomedical Imaging and Image Processing, Biomedical Informatics and Telemedicine, Biomechanics and Rehabilitation Engineering, Biomaterials and Drug Delivery Systems.



A S...  
 Ph...  
 Moh...  
 Uni...  
 In...

Abstract: The  
 country. The  
 (PV) panel  
 implies the  
 order to get  
 ( $E_p$ ) and  
 interpolation  
 technique of  
 prediction  
 as the value  
 well agree  
 transmission  
 performance

Keywords:  
 pumped, R

I. Introduction  
 This  
 and the  
 the main  
 (by using  
 induction  
 Q and  
 the main  
 Pump, W  
 The  
 country  
 where the  
 pumped  
 and used  
 at a rate  
 4)  
 E-  
 A. A. A.  
 The  
 population  
 the pro  
 based  
 strong

Received  
 2016

CONTENTS:

1. A Simplified but Accurate Prevision Method for A Stand-Alone Photovoltaic Pumping System using Linear Interpolation/Extrapolation *Mohammed Yaichi, Abdelkrim Mammeri, Sid-Ali Chikhi, and Mohammed-Karim Fellah* ----- 461
2. Prototype Design and Analysis of Miniature Pulse Discharge Current Generator on Various Burdens *Waluyo, Syahrial, Sigit Nugraha, and Yudhi Permana JR* ---- 472
3. Performance Evaluation of DFIG During Asymmetrical Grid Disturbances Using Internal Model Controller and Resonant Controller *D.V.N. Ananth and G.V. Nagesh Kumar* ----- 494
4. A New Learning and Fuzzy Strategy for Active Power Filtering *Hichem Laib, Abd Elaziz Chaghi and Patrice Wira* ----- 518
5. Multi Objective Generation Dispatch of a Hybrid System with Fuzzy based Space Search Algorithm *Prakash Kumar Hota, Nakul Charan Sahu and Ajit Kumar Barisal* ----- 528
6. Reconstruction of Holographic Microscopy Images Based on Matching Pursuits on A Pair of Domains *Andriyan Bayu Suksmo and Akira Hirose* ----- 553
7. Optimal Location for Fixing Fuel Cells in a Distributed Generation Environment using Hybrid Technique *T.C.Subramanyam, S.S.Tulasi Ram, and JBV Subrahmanyam* ----- 567
8. Toward CMOS Process-Compatible Gold Nanoparticles Deposition with Pattern for Electronics Application *Irman Idris, Muhammad Amin S., Gilang Mardian K., and Akhmadi Surawijaya* ----- 588
9. An Inclusive Review on Load Frequency Control in Deregulated Market *Shital M. Pujara and Chetan D. Kotwal* ----- 595
10. An Efficient Video Watermark Method with Adaptive Use of Block QP *DongHwan Shin and JungUk Choi* ----- 612
11. EMF Estimation of Over Head Transmission Line Using CS Algorithm with Aid of NFC *P. Sivakami and P. Subburaj* ----- 625
12. State Elimination in Accelerated Multiagent Reinforcement Learning *Ary Setijadi Prihatmanto, Widyawardana Adiprawita, Safreni Candra Sari, and Kuspriyanto* ----- 646
13. Assessment of Partial Discharge Signatures in Transformer Oil Insulation using Hidden Markov Model *M. Balasubramanian and S. Venkatesh* ----- 661
14. Particle Filter-based Multitarget Multicamera Tracking System utilizing Random Finite Sets and Distributed Estimation Process *Lenni Yulianti, Bambang Riyanto Trilaksono, Ary Setijadi Prihatmanto, and Widyawardana Adiprawita* ----- 676
15. COA Based SSSC and STATCOM Optimal Controllers Designing with The Aim of Better Damping of Oscillations: A Comparative Study *Behrouz Mohammadzadeh, Reza Gholizadeh-Roshanagh, Sajad Najafi-Ravadanegh and Seyed Reza Seyed Nouri* ----- 697

## ARCHIVES



Vol. 8 No. 3, September 2016


- A Simplified but Accurate Prevision Method for A Stand-Alone Photovoltaic Pumping System using Linear Interpolation/Extrapolation** Mohammed Yaichi<sup>1</sup>, Abdelkrim Mammeri<sup>1</sup>, Sid-Ali Chikhi<sup>1</sup>, and Mohammed-Karim Fellah<sup>2</sup> (1Unité de Recherche en Energies Renouvelables en Milieu Saharien, URERMS, Centre de, Développement des Energies Renouvelables, CDER, 01000, Adrar, Algeria 2Intelligent Control and Electrical Power Systems Laboratory, Djillali Liabes University of Sidi-Bel-Abbes, Algeria [DOI: 10.15676/ijeei.2016.8.3.1])  
**Download** 637 times
- Prototype Design and Analysis of Miniature Pulse Discharge Current Generator on Various Burdens** Waluyo, Syahrial, Sigit Nugraha, and Yudhi Permana JR (Department of Electrical Engineering, Institut Teknologi Nasional (Itenas), Bandung, Indonesia [DOI: 10.15676/ijeei.2016.8.3.2])  
**Download** 617 times
- Performance Evaluation of DFIG During Asymmetrical Grid Disturbances Using Internal Model Controller and Resonant Controller** D.V.N. Ananth<sup>1</sup> and G.V. Nagesh Kumar<sup>2</sup> (1Dept. of Electrical & Electronics Engineering, DADI Institute of Engineering & Technology, (DIET), Anakapalli, Visakhapatnam, India 2 Dept. of Electrical & Electronics Engineering, GITAM University, Visakhapatnam, India [DOI: 10.15676/ijeei.2016.8.3.3])  
**Download** 610 times
- A New Learning and Fuzzy Strategy for Active Power Filtering** Hichem Laib<sup>1</sup>, Abd Elaziz Chaghi<sup>1</sup> and Patrice Wira<sup>2</sup> (1Department of Electrical Engineering, LSPIE Laboratory, Batna University, Algeria, 2MIPS Laboratory, University of Haute Alsace, Mulhouse, France [DOI: 10.15676/ijeei.2016.8.3.4])  
**Download** 587 times
- Multi Objective Generation Dispatch of a Hybrid System with Fuzzy based Space Search Algorithm** Prakash Kumar Hota<sup>1</sup>, Nakul Charan Sahu<sup>2</sup> and Ajit Kumar Barisal<sup>1</sup> (1Department of Electrical Engineering, V.S.S.U.T, Burla, Odisha, India 2Department of Electrical Engineering, I.T.E.R, Bhubaneswar, Odisha, India [DOI: 10.15676/ijeei.2016.8.3.5])  
**Download** 601 times
- Reconstruction of Holographic Microscopy Images Based on Matching Pursuits on A Pair of Domains** Andriyan Bayu Suksmono<sup>1</sup> and Akira Hirose<sup>2</sup> (1School of Electrical Engineering and Informatics, Institut Teknologi Bandung, Jl. Ganesha No.10, Bandung 40132, Indonesia 2Department of Electrical Engineering and Information Systems, The University of Tokyo [DOI: 10.15676/ijeei.2016.8.3.6])  
**Download** 614 times
- Optimal Location for Fixing Fuel Cells in a Distributed Generation Environment using Hybrid Technique** T.C.Subramanyam<sup>1</sup>, S.S.Tulasi Ram<sup>2</sup>, and JBV Subrahmanyam<sup>3</sup> (1.2JNTU College of Engineering, Hyderabad, Electrical& Electronics Engineering 3Christu jyothi institute of technology science, Jangaon town, Warangal [DOI: 10.15676/ijeei.2016.8.3.7])  
**Download** 608 times
- Toward CMOS Process-Compatible Gold Nanoparticles Deposition with Pattern for Electronics Application** Irman Idris<sup>1.2</sup>, Muhammad Amin Sulthoni<sup>1.2</sup>, Gilang Mardian Kartiwa<sup>2</sup>, and Akhmadi Surawijaya<sup>2</sup> (1School of Electrical Engineering and Informatics, Institut Teknologi Bandung, Indonesia 2Microelectronics Center, Institut Teknologi Bandung, Indonesia [DOI: 10.15676/ijeei.2016.8.3.8])  
**Download** 587 times
- An Inclusive Review on Load Frequency Control in Deregulated Market** Shital M. Pujara<sup>1</sup> and Chetan D. Kotwal<sup>2</sup> (1EE. Dept, Charusat University, Gujarat, India 2EE. Dept., SVIT, Vasad, Gujarat, India [DOI: 10.15676/ijeei.2016.8.3.9])  
**Download** 597 times
- An Efficient Video Watermark Method with Adaptive Use of Block QP** DongHwan Shin and JungUk Choi (MarkAny Inc. 10F, Ssanglim Bldg, 286, Toegy-e-ro, Chung-gu, Seoul, Korea [DOI: 10.15676/ijeei.2016.8.3.10])  
**Download** 606 times
- EMF Estimation of Over Head Transmission Line Using CS Algorithm with Aid of NFC** P. Sivakami<sup>1</sup> and P. Subburaj<sup>2</sup> (1Department of Electrical and Electronics Engineering, Unnamalai Institute of Technology, Kovilpatti, Thoothukudi District, Tamilnadu 2Department of Electrical and Electronics Engineering, National Engineering College, Kovilpatti [DOI: 10.15676/ijeei.2016.8.3.11])  
**Download** 643 times
- State Elimination in Accelerated Multiagent Reinforcement Learning** Ary Setijadi Prihatmanto, Widyardana Adiprawita, Safreni Candra Sari, and Kuspriyanto (Department of Electrical Engineering, School of Electrical Engineering and Informatics, Bandung Institute of Technology, Jalan Ganesha 10, Bandung, 40132, Indonesia [DOI: 10.15676/ijeei.2016.8.3.12])  
**Download** 583 times

## ABOUT IJEEI

- [Aims & Scope](#)
- [Editorial Board](#)
- [Current Papers](#)
- [Contact IJEEI](#)
- [Archives](#)
- [Manuscript Preparation](#)
- [Policies](#)
- [Submission](#)

## SEARCH

Type your search here...!



Visitors since January 2010  
439070

Today's visitors  
70



Visitors	
IN 76,642	MA 7,194
ID 49,293	IQ 5,765
DZ 21,055	EG 4,930
US 10,890	MY 3,918
IR 8,090	TN 2,861

FLAG counter

13. **Assessment of Partial Discharge Signatures in Transformer Oil Insulation using Hidden Markov Model** M. Balasubramanian and S. Venkatesh (*1Department of Electrical and Electronics Engineering, School of Electrical and Electronics, Engineering, SASTRA University, Thanjavur - 613401, India. 2Department of Electrical Engineering, School of Electrical Engineering, VIT University, Vellore – 632 014, India [DOI: 10.15676/ijeei.2016.8.3.13]*)  
**Download** 625 times
14. **Particle Filter-based Multitarget Multicamera Tracking System utilizing Random Finite Sets and Distributed Estimation Process** Lenni Yulianti, Bambang Riyanto Trilaksono, Ary Setijadi Prihatmanto, and Widyawardana Adiprawita (*School of Electrical Engineering and Informatics, Institut Teknologi Bandung, Indonesia [DOI: 10.15676/ijeei.2016.8.3.14]*)  
**Download** 604 times
15. **COA Based SSSC and STATCOM Optimal Controllers Designing with The Aim of Better Damping of Oscillations: A Comparative Study** Behrouz Mohammadzadeh<sup>1</sup>, Reza Gholizadeh-Roshanagh<sup>2</sup>, Sajad Najafi-Ravadanegh<sup>2</sup> and Seyed Reza Seyed Nouri<sup>1</sup> (*1Young Researchers and Elite Club, Germi Branch, Islamic Azad University, Germi, Iran 2Smart Distribution Grid Research Lab, Department of Electrical Engineering, Azarbaijan Shahid Madani University, Tabriz, Iran [DOI: 10.15676/ijeei.2016.8.3.15]*)  
**Download** 612 times

## International Journal on Electrical Engineering and Informatics

### EDITOR IN CHIEF:

Suwarno

School of Electrical Engineering and Informatics  
Institut Teknologi Bandung (ITB), Indonesia

### CO-EDITORS:

Andriyan Bayu Suksmono (ITB, Indonesia)  
Dwi Hendratmo Widyantoro (ITB, Indonesia)  
Umar Khayam (ITB, Indonesia)

### EDITORIAL BOARDS:

Adang Suwandi Ahmad (ITB, Indonesia)  
Bambang Riyanto Trilaksono (ITB, Indonesia)  
Pekik Argo Dahono (ITB, Indonesia)  
Arief Syaichu Rohman (ITB, Indonesia)  
Masayuki Hikita (Kyushu Institute of Technology, Japan)  
Guan-Jun Zhang (Xi'an Jiaotong University, China)  
Bang-Wook, Lee (Hanyang University, Ansan, Korea)  
Michael Muhr (Graz Technical University, Austria)  
Ramjee Prasad (Aalborg University, Denmark)  
L. P. Ligthart (TU Delft, The Netherlands)  
Bambang Parmanto (Pittsburgh Univ., USA)  
Anak Agung Julius (Rensselaer Polytechnic Institute, USA)  
Anavatti Sreenatha (ADFA, UNSW, Australia)  
Dina S. Laila (University of Southampton, UK)  
A. Razak Hamdan (Universiti Kebangsaan Malaysia, Malaysia)  
R. Sarathi (Indian Institute of Technology Madras, India)  
Zuzana Oplatková (Tomas Bata Univ., Czech Rep)  
Tian-Hua Liu (NTUST, Taiwan)  
Gian Carlo Montanari (University of Bologna, Italy)  
Ernst Gockenbach (Hannover University of Tech., Germany)  
Yao-We Chang (National Taiwan University, Taiwan)

### Published by: School of Electrical Engineering and Informatics

Institut Teknologi Bandung  
Jl. Ganesha 10 Bandung 40132, Indonesia  
Tel.: +62-22-2502260  
Fax.: +62-22-2534222  
✉ ijeei@stei.itb.ac.id  
<http://www.ijeei.org>

### Indexed by:

- Scopus - Index Copernicus - Scholar Google  
- DOAJ (Direct Open Access Journal) - EBSCO - ProQuest

International Journal  
electrical engineering  
Engineering and Info

### Scope:

The journal publishes  
the following scope:

- **Power Engineering**  
Electric Power G  
Economic, FACT  
Engineering Ma  
Detection and P
- **Telecommunications**  
Antenna and W  
and Mobile Co  
Microwave, Rad  
Services, Secur
- **Computer Engineering**  
Computer Arch  
Network, Embe  
Security, VLSI  
High Performan
- **Control and Co**  
Optimal, Robu  
Identification,  
and Scheduling  
and Neural Net
- **Electronics**  
To Study Micr  
Specific Integre  
Tools.
- **Information T**  
Digital Signal  
Intelligent Sys  
Next Generati
- **Informatics**  
Information S  
System, Distri  
Network Secur
- **Data and Soft**  
Software Engi  
Methods), Pr  
Knowledge I  
Management
- **Biomedical E**  
Biomedical Pl  
Projects, Med  
and Image Pr  
Engineering,



## EDITORIAL BOARD

### EDITOR IN CHIEF:

Suwarno

School of Electrical Engineering and Informatics  
Institut Teknologi Bandung (ITB), Indonesia

### CO-EDITORS:

Andriyan Bayu Suksmono (ITB, Indonesia)

Umar Khayam (ITB, Indonesia)

Adit Kurniawan (ITB, Indonesia)

Rinaldi Munir (ITB, Indonesia)

Achmad Munir (ITB, Indonesia)

Emir Mauludi Husni (ITB, Indonesia)

Arif Sasongko (ITB, Indonesia)

Saiful Akbar (ITB, Indonesia)

Hasballah Zakaria (ITB, Indonesia)

### EDITORIAL BOARDS:

Bambang Riyanto Trilaksono (ITB, Indonesia)

Arief Syaichu Rohman (ITB, Indonesia)

Masayuki Hikita (Kyushu Institute of Technology, Japan)

Guan-Jun Zhang (Xi'an Jiaotong University, China)

Bang-Wook, Lee (Hanyang University, Ansan, Korea)

Michael Muhr (Graz Technical University, Austria)

L. P. Ligthart (TU Delft, The Netherlands)

Bambang Parmanto (Pittsburgh Univ., USA)

Anak Agung Julius (Rensselaer Polytechnic Institute, USA)

Anavatti Sreenatha (ADFA, UNSW, Australia)

Dina S. Laila (University of Southampton, UK)

R. Sarathi (Indian Institute of Technology Madras, India)

Tian-Hua Liu (NTUST, Taiwan)

Ernst Gockenbach (Hannover University of Tech., Germany)

Hans Dulimarta (Grand Valley State University, United States)

Thomas Hardjono (Massachusetts Institute of Technology, USA)

Ahmed Abu Siada (Curtin University, Australia)

Nurhidayat Sisworahardjo (The University of Tennessee, USA)

Udaya Madawala (The University of Auckland, New Zealand)

Eduard Muljadi (Auburn University, Alabama, USA)

M.V. Reddy (Institute of Research Hydro Quebec, Canada)

## ABOUT IJEEI

- [Aims & Scope](#)
- [Editorial Board](#)
- [Current Papers](#)
- [Contact IJEEI](#)
- [Archives](#)
- [Manuscript Preparation](#)
- [Policies](#)
- [Submission](#)

## SEARCH



Visitors since January 2010  
439073

Today's visitors  
73



Country	Visitors
IN	76,642
ID	49,293
DZ	21,055
US	10,890
IR	8,090
MA	7,194
IQ	5,765
EG	4,930
MY	3,918
TN	2,861





## CONTACT IJEI

Published by :

**School of Electrical Engineering and Informatics  
Institut Teknologi Bandung**

Jalan Ganesha 10

Bandung, 40132

INDONESIA

Phone : +62-22-2502260

IP Phone : +62-22-4254028

Fax : +62-22-2534222

Website: <http://www.ijeei.org>

e-mail: [ijeei@itb.ac.id](mailto:ijeei@itb.ac.id)

## ABOUT IJEI

- [Aims & Scope](#)
- [Editorial Board](#)
- [Current Papers](#)
- [Contact IJEI](#)
- [Archives](#)
- [Manuscript Preparation](#)
- [Policies](#)
- [Submission](#)

## SEARCH



Visitors since January 2010  
439074

Today's visitors  
74



Visitors					
	IN	76,642		MA	7,194
	ID	49,293		IQ	5,765
	DZ	21,055		EG	4,930
	US	10,890		MY	3,918
	IR	8,090		TN	2,861

FLAG counter

# International Journal on Electrical Engineering and Informatics

## COUNTRY

Indonesia



Universities and research institutions in Indonesia

## SUBJECT AREA AND CATEGORY

Engineering

└ Engineering (miscellaneous)

## PUBLISHER

The School of Electrical Engineering and Informatics, Institut Teknologi Bandung

## H-INDEX

20

## PUBLICATION TYPE

Journals

## ISSN

20856830, 20875886

## COVERAGE

2009-2021


## INFORMATION

[Homepage](#)[How to publish in this journal](#)[ijeei@stei.itb.ac.id](mailto:ijeei@stei.itb.ac.id)

## SCOPE









International Journal on Electrical Engineering and Informatics is a peer reviewed journal in the field of electrical engineering and informatics. The journal is published quarterly by The School of Electrical Engineering and Informatics, Institut Teknologi Bandung, Indonesia. All papers will be blind reviewed. Accepted papers will be available on line (free access) and printed version.

Join the conversation about this journal

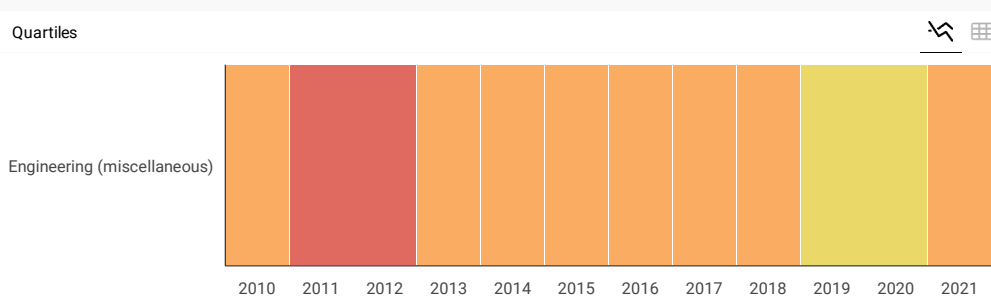

1  
**Iranian Journal of Science and Technology - CHE**  
64%  
 similarity

2  
**Electrical Engineering**  
 DEU  
55%  
 similarity

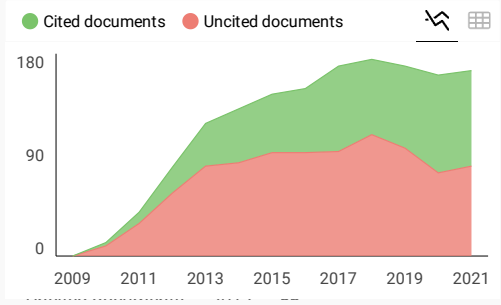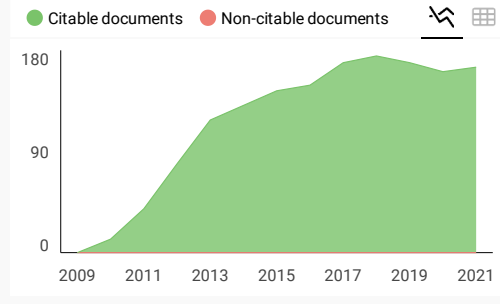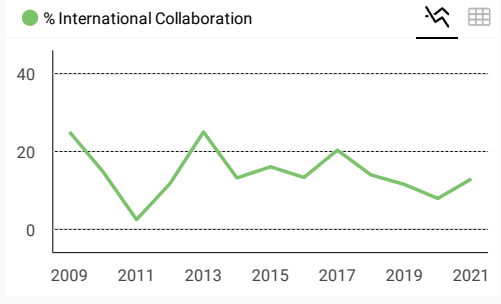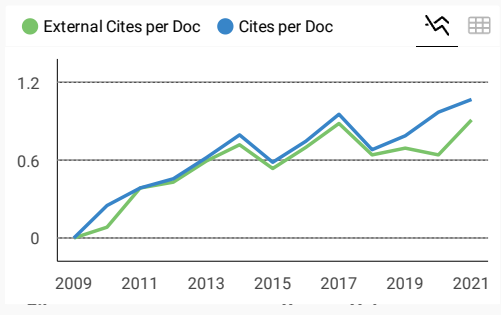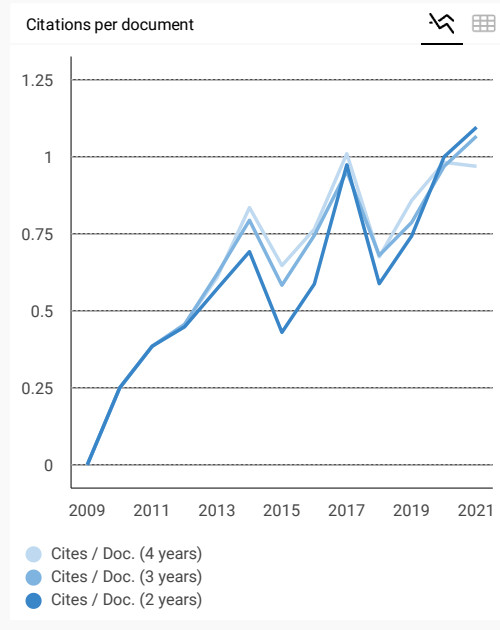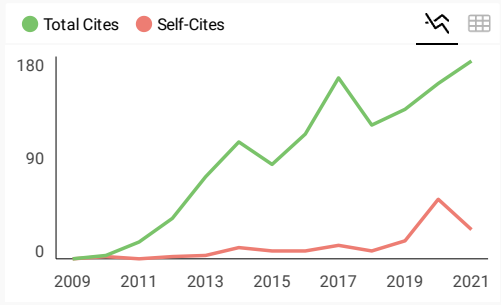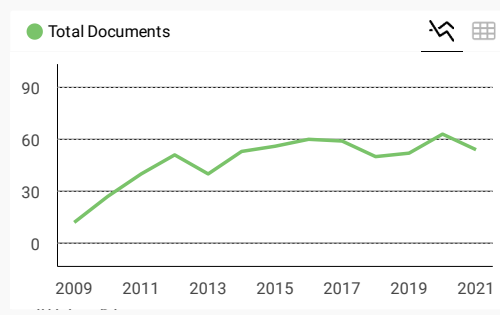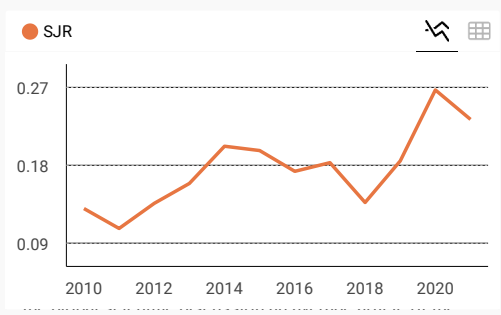

← Show this widget in your own website

Just copy the code below and paste within your html code:

```
<a href="https://www.scimagojr.com
```

**SCImago Graphica**

Explore, visually communicate and make sense of data with our **new data visualization tool**.



**mohammed blakit** 8 months ago

thank you for response and attention  
can regard this journal in Scopus indexed to date?

← reply



**Melanie Ortiz** 8 months ago

SCImago Team

Dear Mohammed, thank you very much for your comment. We suggest you consult the Scopus database directly. Keep in mind that the SJR is a static image (the update is made one time per year) of a database (Scopus) which is changing every day. The Scopus' update list can also be consulted here: <https://www.elsevier.com/solutions/scopus/how-scopus-works/content>  
Best Regards, SCImago Team



**mohammed blakit** 8 months ago

why the Scopus coverage period from 2009 to 2021 and we in may 2022?

← reply



**Melanie Ortiz** 8 months ago

SCImago Team

Dear Mohammed,  
Thank you very much for your comment.  
All the metadata have been provided by Scopus /Elsevier in their last update sent to SCImago, including the Coverage's period data. The SJR for 2021 was released on May 2022. We suggest you consult the Scopus database directly to see the current index status as SJR is a static image of Scopus, which is changing every day. The Scopus' update list can also be consulted here: <https://www.elsevier.com/solutions/scopus/how-scopus-works/content>  
Best Regards, SCImago Team



**khaled Al-Qaoud** 1 year ago

Dear Sir/Madam  
I am trying to classify a journal with ISSN 2085-6830 based on the quartile classification. Scopus website gives 47% which should equal third quartile but your website Scimago shows 2nd quartile. please help

← reply



**Melanie Ortiz** 1 year ago

SCImago Team

Dear Khaled , Thank you for contacting us.  
As you probably already know, our data come from Scopus, they annually send us an update of the data. This update is sent to us around April / May every year. The calculation of the indicators is performed with the copy of the Scopus database provided to us annually. However, the methodology used concerning the distribution by Quartiles by Scopus is different from the one used by SCImago.  
For every journal, the annual value of the SJR is integrated into the distribution of SJR

values of all the subject categories to which the journal belongs. There are more than 300 subject categories. The position of each journal is different in any category and depends on the performance of the category, in general, and the journal, in particular. The distribution by Quartiles cannot be considered over the journals' total amount within a Category. In the case of SCImago, the distribution has to be considered with the formula Highest-SJR minus Lowest-SJR divided into four.

Best Regards,  
SCImago Team



**wisal** 2 years ago

Is this journal under Scopus coverage?

← reply



**Melanie Ortiz** 1 year ago

SCImago Team

Dear Wisal,  
Thank you very much for your comment.  
All the metadata have been provided by Scopus /Elsevier in their last update sent to SCImago, including the Coverage's period data. The SJR for 2020 has been released on 17 May 2021. We suggest you consult the Scopus database directly to see the current index status as SJR is a static image of Scopus, which is changing every day.  
Best Regards, SCImago Team



**pronika** 2 years ago

international journal on electrical engineering and informatics give response in how much time. plz suggest u have any idea regarding time which take by journal for publication.

← reply



**Hafsa Dar** 12 months ago

Hi, normally they take 3-4 months to provide first review/feedback and the time varies upon revised submission which is few days to 3 months. I am responding based on my experience with the journal  
Hope this info helps



**Melanie Ortiz** 2 years ago

SCImago Team

Dear Pronika,  
thank you for contacting us.  
Unfortunately, we cannot help you with your request, we suggest you visit the journal's homepage or contact the journal's editorial staff , so they could inform you more deeply.  
Best Regards, SCImago Team



**Soumia** 2 years ago

hi  
Is there a charge for this paper, if so, how much?

← reply



**Melanie Ortiz** 2 years ago

SCImago Team

Dear Soumia,  
thank you for contacting us.  
Unfortunately, we cannot help you with your request, we suggest you visit the journal's homepage or contact the journal's editorial staff , so they could inform you more deeply.  
Best Regards, SClmago Team

A

**adel** 3 years ago

hello

i want to know if this journal is still under scopus coverage ?

am asking this question because i read that the coverage of this journal is from 2009 to 2019... and now we are in 2020!

So is it still under scopus coverage

Thanks in advance

← reply



**Melanie Ortiz** 2 years ago

SClMago Team

Dear Adel,

Thank you very much for your comment.

All the metadata have been provided by Scopus /Elsevier in their last update sent to SClmago, including the Coverage's period data. The SJR for 2019 was updated on June 2020, 11. We suggest you consult the Scopus database directly to see the current index status as SJR is a static image of Scopus, which is changing every day.

Best Regards, SClmago Team

A

**ahmed khudhair** 3 years ago

hi

how can i contact this journal

Hello i would like ask for total fees in your journal

And now the total pages is 11 include abstract reference all of things

How much you have charge me

← reply



**Melanie Ortiz** 3 years ago

SClMago Team

Dear Ahmed,

thank you for contacting us.

We are sorry to tell you that SClmago Journal & Country Rank is not a journal. SJR is a portal with scientometric indicators of journals indexed in Elsevier/Scopus.

Unfortunately, we cannot help you with your request, we suggest you visit the journal's homepage or contact the journal's editorial staff , so they could inform you more deeply.

Best Regards, SClmago Team

A

**Asep Najmu** 3 years ago

Dear Sir/Madam,

How to compute the SJR of each the journal ? Is the Quartile of A Journal derived from its SJR ? If Journal A has the SJR bigger than Journal B, should Journal A have the Quartile higher than Journal B ?

Thanks a lot for your response.

← reply



**Melanie Ortiz** 3 years ago

SCImago Team

Dear Asep,

Thank you for contacting us.

In the case of SCImago, the distribution in Quartiles has to be considered with the formula Higher-SJR minus Lowest-SJR divided into four. For example, if in a Category X, the lowest SJR is 1.01 (considered Q4) and the highest is 2.67 (considered Q1), the distribution will be made by calculating 2.67-1.01 into four quarters.

Best Regards, SCImago Team



**DHEERAJ KUMAR DHAKED** 3 years ago

is it SCI indexed

← reply



**Melanie Ortiz** 3 years ago

SCImago Team

Dear Dheeraj, SCImago Journal and Country Rank uses Scopus data, our impact indicator is the SJR. Check our page to locate the journal. We suggest you consult the Journal Citation Report for other indicators (like Impact Factor) with a Web of Science data source. Best Regards, SCImago Team



**Kuruvilla John** 4 years ago

Dear sir/madam

Can anyone tell how much time will be taken for review in this journal.

← reply

### Leave a comment

Name

Email

(will not be published)

I'm not a robot



reCAPTCHA  
Privacy - Terms

Submit

The users of Scimago Journal & Country Rank have the possibility to dialogue through comments linked to a specific journal. The purpose is to have a forum in which general doubts about the processes of publication in the journal, experiences and other issues derived from the publication of papers are resolved. For topics on particular articles, maintain the dialogue through the usual channels with your editor.

Developed by:

Powered by:



Follow us on [@ScimagoJR](#)

Scimago Lab, Copyright 2007-2022. Data Source: Scopus®

EST MODUS IN REBUS

Horatio (Satire 1,1,106)

[Edit Cookie Consent](#)





# Source details

Check whether you can access Scopus remotely through your institution

[Maybe later](#) [Check access](#)

1.0

SJR 2021  
**0.233**

SNIP 2021  
**0.437**

## International Journal on Electrical Engineering and Informatics

Open Access ⓘ

Scopus coverage years: from 2009 to 2022

Publisher: The School of Electrical Engineering and Informatics, Institut Teknologi Bandung

ISSN: 2085-6830 E-ISSN: 2087-5886

Subject area: [Engineering: General Engineering](#)

Source type: Journal

[View all documents >](#)

[Set document alert](#)

[Save to source list](#) [Source Homepage](#)

[CiteScore](#) [CiteScore rank & trend](#) [Scopus content coverage](#)

**i** Improved CiteScore methodology ⓘ

CiteScore 2021 counts the citations received in 2018-2021 to articles, reviews, conference papers, book chapters and data papers published in 2018-2021, and divides this by the number of publications published in 2018-2021. [Learn more >](#)

CiteScore **2021** ▾

$$1.6 = \frac{360 \text{ Citations 2018 - 2021}}{219 \text{ Documents 2018 - 2021}}$$

Calculated on 05 May, 2022

CiteScoreTracker 2022 ⓘ

$$1.9 = \frac{402 \text{ Citations to date}}{210 \text{ Documents to date}}$$

Last updated on 05 January, 2023 • Updated monthly

### CiteScore rank 2021 ⓘ

Category	Rank	Percentile
Engineering		
General Engineering	#157/300	47th

[View CiteScore methodology >](#) [CiteScore FAQ >](#) [Add CiteScore to your site ↗](#)

### About Scopus

- [What is Scopus](#)
- [Content coverage](#)
- [Scopus blog](#)
- [Scopus API](#)
- [Privacy matters](#)

### Language

- [日本語版を表示する](#)
- [查看简体中文版本](#)
- [查看繁體中文版本](#)
- [Просмотр версии на русском языке](#)

### Customer Service

- [Help](#)
- [Tutorials](#)
- [Contact us](#)

ELSEVIER

[Terms and conditions ↗](#) [Privacy policy ↗](#)

Copyright © Elsevier B.V. All rights reserved. Scopus® is a registered trademark of Elsevier B.V.

We use cookies to help provide and enhance our service and tailor content. By continuing, you agree to the [use of cookies ↗](#).





## Prototype Design and Analysis of Miniature Pulse Discharge Current Generator on Various Burdens

Waluyo, Syahril, Sigit Nugraha, and Yudhi Permana JR

Department of Electrical Engineering  
Institut Teknologi Nasional (Itenas), Bandung, Indonesia  
waluyo@itenas.ac.id

*Abstract:* High voltage impulse is one of the means used in a variety of insulating materials testing. It causes also discharge, generally as visualization of lightning strikes. This research aimed to design a prototype of miniature current discharge pulse generation with various burdens. The alternating low voltage was rectified first and multiplied by using the modified Cockroft-Walton voltage multiplier. The yielded output voltage was a d.c. high voltage, which subsequently entered the pulse generator circuit, penetrating the sphere gap, after filling the charge on the first capacitor and then fill in the second capacitor. The shape of the output pulse current was tapped by using a resistive voltage divider. Thus, the various pulse current waveforms could be measured and recorded by a storage digital oscilloscope.

Almost first discharge were occurred in around from 1  $\mu\text{s}$  to 2  $\mu\text{s}$ . The waveforms with the pure resistive burdens would trend to be symmetrical to almost on positive parts. On the other hand, the waveforms with the resistive and capacitive dominated burdens would be shorter, i.e. around 16.8  $\mu\text{s}$ , than those resistive dominated burdens. The wave frequency response of discharge on the capacitive dominated burdens would more declivous or prevalent than those on the resistive dominated burdens. The latter characteristics were indicated by the specific capacitive dominated property. The capacitive property that store charge was expected as cause the latter characteristics. The dominated capacitive existence made the repetitive discharge would be shorter than those the dominated resistive existence.

*Keywords:* miniature, pulse, discharge, current, burden

### 1. Introduction

An impulse voltage is a unidirectional voltage, which generally without appreciable oscillation, rises rapidly to a maximum value and falls more or less rapidly to zero value. Small oscillations are tolerated, provided that their amplitudes are less than 5% of the peak values. If the impulse voltage develops without causing flashover of puncture occur, it is called a chopped impulse voltage. A full impulse voltage is characterized by its peak value and its two time interval [1,2].

The actual shape of both kinds of lightning and switching over voltages varies strongly. Nevertheless, it became necessary to simulate these transient voltages by relatively simple means for testing purposes. The various standards define the impulse voltages as a unidirectional voltage which rises more or less rapidly to a peak value and the decays relatively slowly to zero. Impulse voltages with front durations varying from less than one up to a few tens of microseconds are considered as lightning impulse generally. Lightning impulses are very short duration, mainly if they are chopped on front [3].

Transient over voltages due to lightning and switching surges cause steep build-up of voltage on transmission lines and other electrical apparatus. The experimental investigations showed that these waves have a rise time of 0.5 to 10  $\mu\text{s}$  and decay time to 50% of the peak value of the order 30 to 200  $\mu\text{s}$ . The wave shapes are arbitrary, but mostly unidirectional. It is shown that lightning overvoltage wave can be represented as double exponential waves defined by the equation (1).

---

Received: August 30<sup>th</sup>, 2015. Accepted: September 25<sup>th</sup>, 2016

DOI: 10.15676/ijeei.2016.8.3.2

$$V = V_o \left[ e^{-\alpha t} - e^{-\beta t} \right] \quad (1)$$

where  $\alpha$  and  $\beta$  are constants of microsecond values. This equation represents a unidirectional wave which usually has a rapid rise to the peak value and slowly falls to zero value [4].

A simple, approximate mathematical expression for 8/20  $\mu$ s short circuit current waveform that is specified in the standards is  $I(t)$ , as given by equation (2).

$$I(t) = A I_p t^3 e^{\left(-\frac{t}{\tau}\right)} \quad (2)$$

Nevertheless, for current impulses on his research results, the delay time, rise time and full width at half-maximum values were 16.2  $\mu$ s, 8.02  $\mu$ s and 20.7  $\mu$ s respectively [5].

The electrical strength of high voltage apparatus against external over voltages that can appear in power supply systems due to lightning strokes is tested with lightning impulse voltages. The rising part of the impulse voltage is referred to as the front, the maximum as the peak and the decreasing part as the tail. The waveforms can be represented approximately by supervision of two exponential functions with differing time constants [6]. The standard lightning impulse is described as a 1.2/50  $\mu$ s wave, and the standard switching impulse is a 250/2500  $\mu$ s wave [7].

A development of Matlab Simulink model has been carried out for the experimental setup above. The results of the investigation showed that it was very efficient in the learning effect of changes in the design parameters to obtain the impulse voltage and the desired waveform of the impulse voltage generator for high voltage applications [8].

It has been conducted a series of simulations to adjust the formation of the output of a kind type of Marx impulse generator. The goal was to estimate the leak capacitance and capacitance insert into circuit simulation to effectively produce an output that was similar to the generator. An actual three-stage impulse generator, with several different levels of impulse voltage test and the recorded output waveform, was used as a basis. The research was carried out to formulate the capacitance leak and identifying the location of capacitance in the generator. The research showed that an effective simulation of the circuit could be created to provide output as close as possible [9].

It has been made the development of Marx generator type vertical structure twenty steps. In a matching load of 90-100, it has been obtained for 25 kV DC discharge, a pulse output voltage 230 kV, and a duration of 150 ns. This voltage pulse was applied to a relativistic electron beam planar diode. For a cathode-anode gap of 7.5 mm, it has been obtained an REB had shot 160 kV voltage and duration of 150 ns [10].

It has been developed an impulse generator circuit using OrCAD PSpice software to generate a waveform lightning according to IEC61000-4-5 standard. For this purpose, it has been used as Marx generator main principles of design with a few modifications to the parameters and components. The waveform output of the simulation compared to the surge as IEC61000-4-5 standards, and the values in the series developed arranged so that the characteristics of the waveform in the limits of the acceptable. As a result, the true lightning waveforms in the form of voltage versus time were raised from an impulse generator circuit [11].

It has been described how to calculate constant impulse voltage generator circuit with the impulse voltage was given. From the results, it appeared that the effect of the revision of the definition depended on the circuit constants [12].

It has been done the design, construction and analysis of the uncertainty of impulse voltage calibrator that could be calculated. The calibrator was as the primary reference for the measurement of impulse voltage. It generated impulse voltage with the peak, front and tail values were known. The peak voltage range was constructed from 50 mV to 1000 V [13].

The electrical characteristics and description of low inductance design, compact, 500 kV, 500 A, 10 Hz repetition rate, Marx generator for generating a high-power microwave source or high power microwave (HPM) has been presented. This included the analysis of relevant background of the Marx generator and HPM source [14].

The trigger pulses of high voltage were required for initial conduction in a triggered spark gap that require a high impedance voltage source. This work illustrated the design, construction and operation of two high-voltage pulse generator and a spark gap [15].

It has been presented the parameter optimization technology for the generation of lightning current waveforms for first short stroke (10/350  $\mu$ s) which was needed to test the performance of lightning protection components, as required in IEC 62305 and IEC 62561. The crowbar devices were specified in IEC 62305 that was applied to generate lightning current waveform. The results, in this experiment were the new parameters of the circuit needed to be changed because of the difference between the simulation and experimental results. An external coil type multistage and a damping resistor have been proposed to make the generation efficiency increased. According to these results, it was obtained by an optimization of the lightning current waveform first short stroke [16].

Impulse generators were implemented as digital switching circuits to utilize the fast switching speed of CMOS transistors and save power. In the single-polarity DWG prototype, the impulse generator is designed based on a glitch generator [17].

When the analytical equations were used as an impulse source, it worked as a perfect generator and output waveform characteristics were not dependent on the impedance of the system. It could be confirmed that the waveform characteristics; delay time, rise time and FWHM remain unchanged for two impedance ranges considered when used model equations as generator sources for both voltage and current impulses. It was found that as for 1.2/50  $\mu$ s voltage impulses, delay time, rise time and FWHM values were 4.95  $\mu$ s, 1.20  $\mu$ s and 81.8  $\mu$ s respectively through the tested impedance range. For 8/20  $\mu$ s current impulses, these values were 16.2  $\mu$ s, 8.02 and 20.7  $\mu$ s respectively throughout the tested impedance range. Hence, characteristics of waveforms introduced to the system were not depending on the impedance of the system and no loading effect in action under this scenario. Thus, when the analytical equations were used as impulse sources, both voltage and current source models were performed as ideal generators. Obviously, the waveform characteristics of the generated impulses were varied by the influence of the nonlinear load impedance. These results implies that the impedance of the system load be able to influence the generator characteristics. When impedance of the nonlinear load increased, the characteristics of current impulse waveform were also changed and significantly deviated from the expected values. However, when the impedance was at its lowest value, these parametric values were almost equal to the values obtained when the analytical equation was used as current impulse source. When impedance of the nonlinear load decreased, the characteristics of voltage impulse waveform were also deviated from the expected values. However, when the impedance was at its highest value, these parametric values were almost equal to the values obtained when the analytical equation was used as voltage impulse source. When the analytical equations were used as impulse sources it worked as perfect generators and V-I characteristics were not depend on the impedance of the system. However, V-I characteristics of the generated waveforms are varied significantly by the impedance of the nonlinear load that was connected to the generator circuit models. The deviations were due to influence caused by the nonlinear load to the generator circuit parameters and effective internal impedance [5].

From some of the literature reviews, it is necessary for development in terms of the formation of the prototype, namely in the form of utilization of high voltage generation in line with the full-wave rectifier and utilization of high voltage multiplier results to be used as a source of impulse voltage generation. This research was to design and implement the prototype miniature of impulse high voltage generator based on the results of high voltage d.c. multiplier generator.

The state of the art in this research was a pulse current generation in the miniature prototype, where the sphere gap distance was also very short, around 1.5 mm, and the currents were recorded in various burden scenarios. Thus, the phenomena of current pulse waveforms could be understood in various burdens. For one period, these waveforms were similar to an electrostatic discharge current. However, due to the source was direct current (dc), not a capacitor only, the breakdown discharges were occurred in many times, instead of once. To get some waveform phenomena, it was carried out to give four scenarios to the circuits. The recording system was used the digital storage oscilloscope. The data could be opened, analyzed and made curves by Excel. The data could also be made FFT analyses by using OriginPro. Thus, the trending curves and the frequency spectra could be investigated. Compared to the previous researches, usually, they were simulation works only, so that not considered the distance of sphere gap, or the measurement methods those done were voltage quantity, instead of current. Therefore, in this research, it was recorded the discharge currents practically or in real conditions. At the analyses, the frequency responses of discharge current waveforms were presented also. Thus, the frequency domains would be analyzed too.

## 2. Research Methods

This research was the continuation from the previous one [18]. Nevertheless, it emphasized the miniature sphere gap pulse phenomena due to d.c. high voltages. The block diagram for this circuit design is shown in Figure 1.

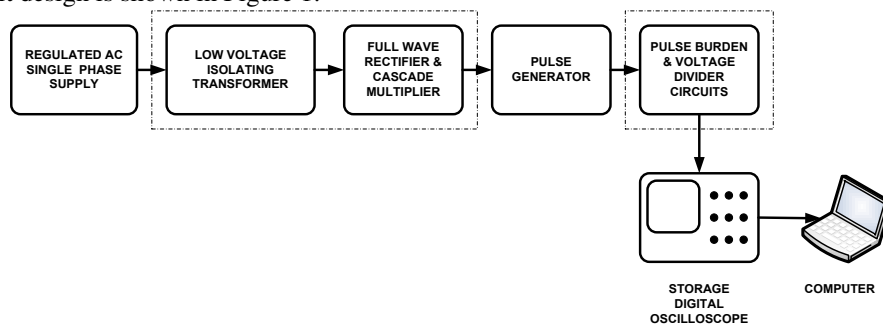


Figure 1. Blok diagram of pulse generator and measurement

From the single phase supply, the electric source entered to the insulating transformer, which isolated the main circuit from power source. The low a.c. voltage was rectified and multiplied by the cascade circuit. For this case, the secondary voltage of transformer was rectified and multiplied by the cascade multiplier circuit. Therefore, it was yielded the d.c. high voltages. The d.c. high voltages were subjected to the air sphere gap, with the gap distances were 1-2 mm in range. Depending upon the d.c. high voltage magnitudes, the air gap between the metal spheres would be breakdown or discharge. There was also the circuit after the metal spheres, namely the pulse burden and voltage divider circuits. The pulse burden circuit was mainly functioned as a current limiter of the discharge current. Therefore, the d.c. cascade circuit would be relatively safe when the metal sphere gap was breakdown. Otherwise, the voltage divider circuit was mainly functioned as measurement purpose, that connected to the storage digital oscilloscope and ultimately connected to the computer. It enable also that the pulse burden circuit was at once as a voltage divider circuit. The measured data were recorded by the computer and could be saved in softcopy forms for further analysis.

Figure 2 shows a simulation circuit of typical impulse burden. There were the resistors, the voltage divider resistors and the capacitors. The voltage divider was for tapping the occurred voltage, and as the input voltage to the channel of the storage digital oscilloscope. However, the measured quantities were the pulse currents. Thus, the real electric current that flow in the pulse burden circuit was as in equation (3).

$$I = \frac{V}{R} \tag{3}$$

where V as the real occurred voltage that measured by the oscilloscope and R was the tapping resistor.

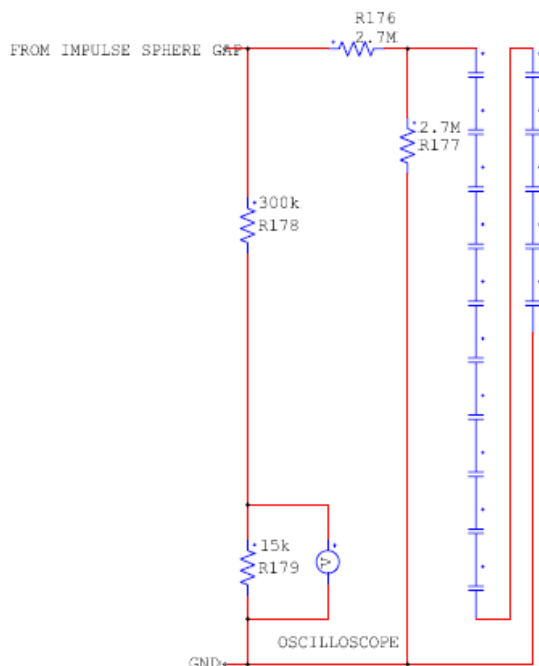


Figure 2. The typical of impulse burden

In assembling of the impulse generation, the main component consisted of transformer diodes, capacitors and resistors. The transformer which used was as step-up transformer, and as insulation transformer, 500 watt, 0.5 ampere. The diode role was very important, where the working principle of the diode is only issued once of the flow, either positive or negative depending on the purposes of the output. In this assembly, it was used the diodes of 25F120/1322 type. The used capacitors were direct current with type of PAG/450Volt-100 $\mu$ F and the resistors were used ceramic type.

The necessary measured quantity was discharge current. However, the oscilloscope could not measure the current quantity, instead of voltage quantity. Nevertheless, the discharge current could be measured by the oscilloscope through series voltage divider resistors. Thus, the discharge current phenomena could be measured indirectly and the measuring equipment was in safe conditions. The measurements were carried out in many times. Nevertheless, they are presented in several results only. They were typical results according to the burden categories.

### 3. Research Results And Discussion

Figure 3 shows the complete assembly of research, including the sphere gap electrodes for impulse generation that have been formed. It is seen that the input of the circuit, such as transformer, to the output circuit, a series of impulse generation, including the sphere gap electrode, capacitor and resistor circuits. Besides that, there were two voltmeters for voltage measuring purposes.

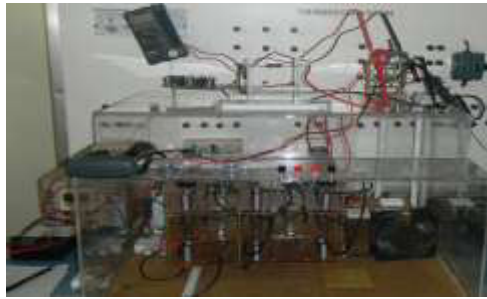


Figure 3. The complete set of pulse generation

Figure 4 shows the miniature sphere gap for pulse generation. The distance of the sphere gap could be adjusted. Nevertheless, in this research, it was typically 0.5 – 2.0 mm in range.

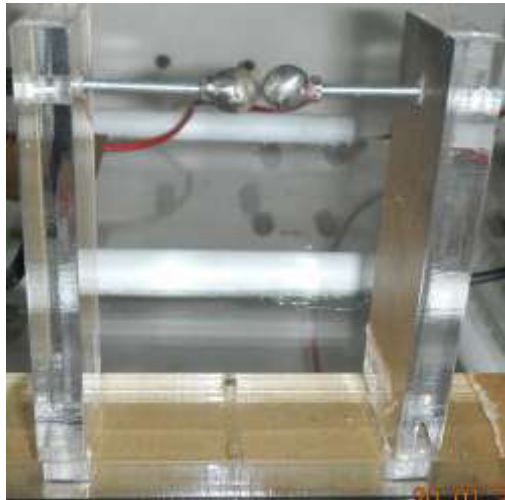


Figure 4. The sphere gap electrodes for impulse generation



(a) Resistor circuit



(b) Capacitor circuit

Figure 5. The resistor and capacitor burden circuits of pulse generation

Figure 5(a) shows the resistors pulse burden and voltage divider circuits, whereas Figure 5(b) shows the capacitors for pulse burden circuits. Both circuits would be used as burdens of pulse generation.

Figure 6 shows the complete set of the pulse current generator, including the measuring devices. First device was a variac, which regulated the input voltage magnitude. Consequently, the dc output voltage that made the pulses would increase too. Furthermore, the electric power entered to the transformer, which the main function was as an insulating circuit, beside as a step-up of voltage. The insulating transformer isolated the circuit between the panel power supply and the main circuit of cascade dc voltage multiplier. The next step was the cascade dc voltage multiplier, which could increase a medium voltage in several kilo volts. After reached the medium voltage, it injected the pulse burdens through the sphere gap electrodes. The pulse burdens consisted of the resistors and capacitors. Some resistors also functioned as a voltage divider, which the small voltage was measured by the oscilloscope.

The data, which were measured by the digital storage oscilloscope, were transferred to the computer. The recorded data were in both bitmap (bmp) and comma separated values (csv) file forms. Thus, based on the csv files, the recorded data could be further analyzed.



Figure 6. The complete circuit of impulse generation and measurement system

Figure 7 shows an example of original bitmap (bmp) picture form of recorded data. It shows the division for voltage (vertical magnitude) and time (horizontal), date and time of measurements, waveforms, acquire, and so on. The picture was also for crosscheck the analyzed data that done by Microsoft excel and other program software. However, on the capture bmp picture, the starting point of time parameter was zero value, that was the central point of horizontal axis.

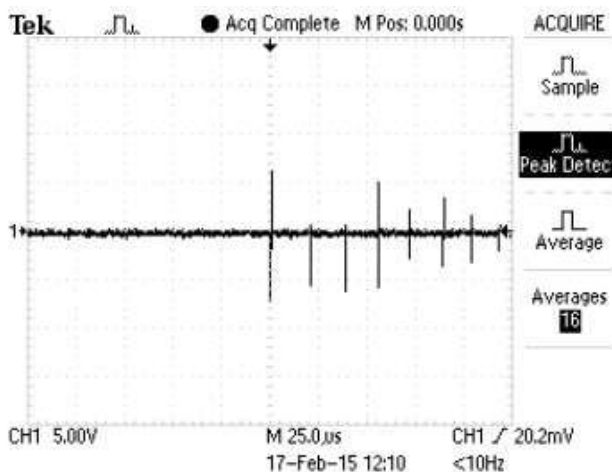


Figure 7. An example of original bmp form of recorded data



Figure 8 presents the first scenario of pulse burden circuits. In this circuit, it was pure resistive burden that parallel two  $2.7\text{ M}\Omega$  and  $300\text{ k}\Omega$  resistors. The measured voltage was tapped on the  $15\text{ k}\Omega$  resistor, which was the input of the oscilloscope.



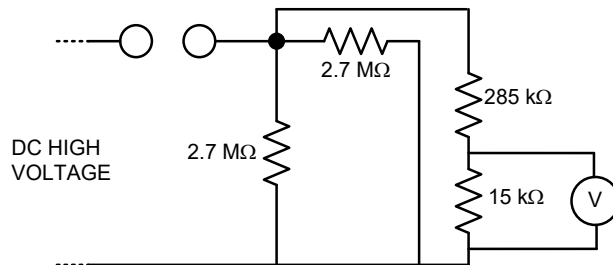


Figure 8. First scenario of pulse burden as short pure resistive circuit


Figure 9 shows the first sample current waveform of measurement result for the first scenario of pulse burden circuit. Figure 9(a) is the first single waveform of discharge pulse. In this waveform, the discharge pulse was occurred in time of  $1\ \mu\text{s}$ , and the specific discharge wave would cease in time of around  $2\ \mu\text{s}$ . Figure 9(b) is the multiple waveform of discharge pulse. The discharge pulses were occurred in time of 31, 51, 67, 86, 101 and  $116\ \mu\text{s}$ , after the first pulse. The average different time among pulses was  $17\ \mu\text{s}$ . Figure 9(c) is the short range of frequency response. The magnitude would increase locally in frequency of 34180, 43945 and  $61035\text{ Hz}$ , and Figure 9(d) is the long range one. Generally, the magnitudes of discharge current would decrease as the frequency increased slightly.

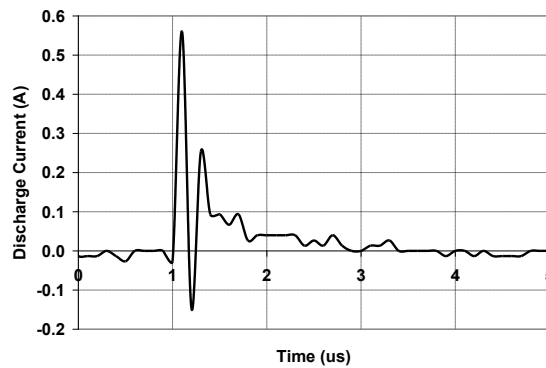


(a) First single waveform

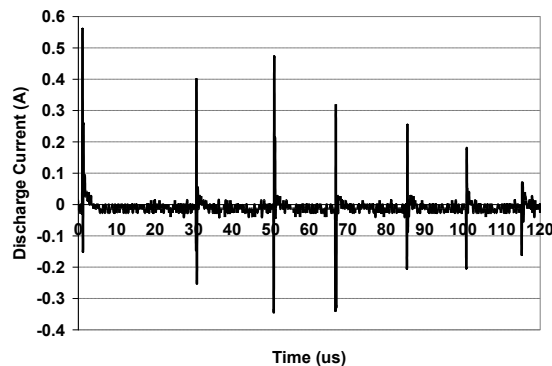

(b) Multiple waveform

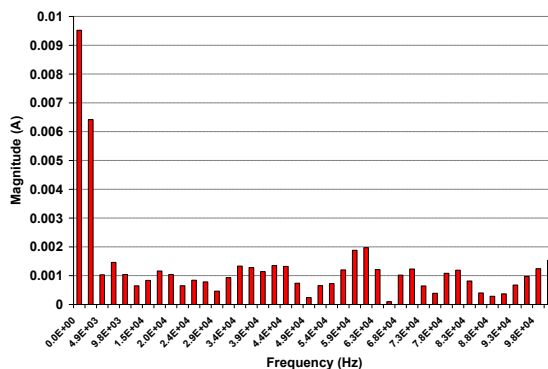


(c) Short range of frequency response

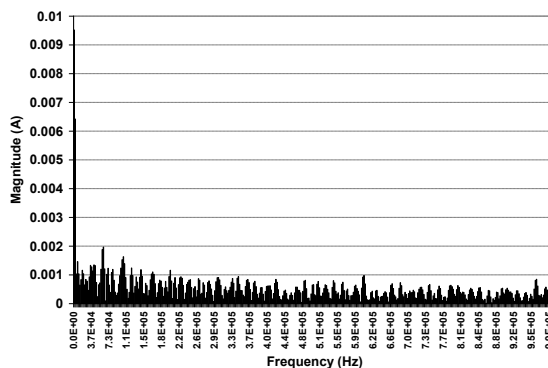


(d) Long range of frequency response

Figure 9. First sample current waveform result for the first scenario of pulse burden circuit


Figure 10 shows the second sample current waveform of measurement result for the first scenario of pulse burden circuit. Figure 10(a) is the first single waveform of discharge pulse. In this waveform, the discharge pulse was occurred in time of around 1  $\mu$ s, and the specific discharge wave would cease in time of around 2  $\mu$ s. Figure 10(b) is the multiple waveform of discharge pulse. In this waveform, the discharge pulses were occurred in time of 26, 45, 66, 83, 98 and 111  $\mu$ s, after the first pulse. The average different time among pulses was 17  $\mu$ s. Figure 10(c) is the short range of frequency response. The magnitude would increase locally in frequency of 31738, 48828 and 61035 Hz, and Figure 10(d) is the long range one, where the magnitudes of discharge current would decrease slightly as the frequency increased.

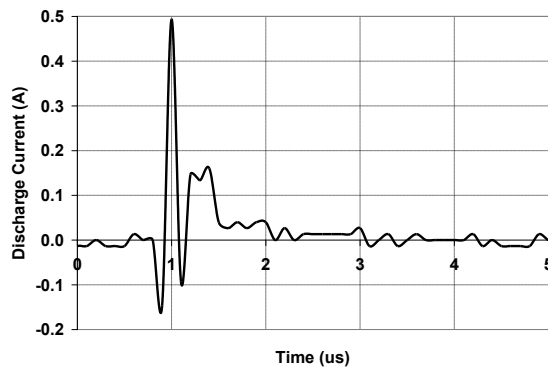


(a) First single waveform

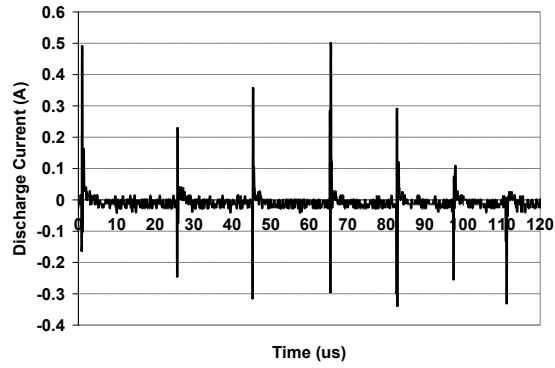

(b) Multiple waveform

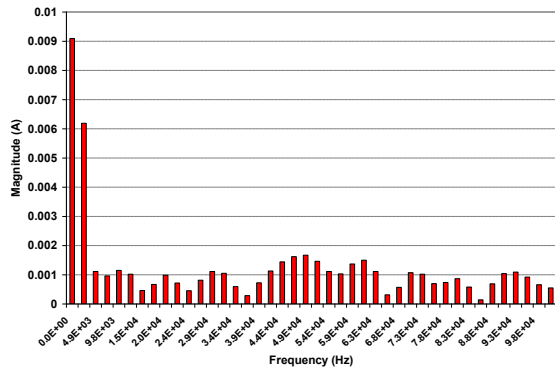

(c) Short range of frequency response

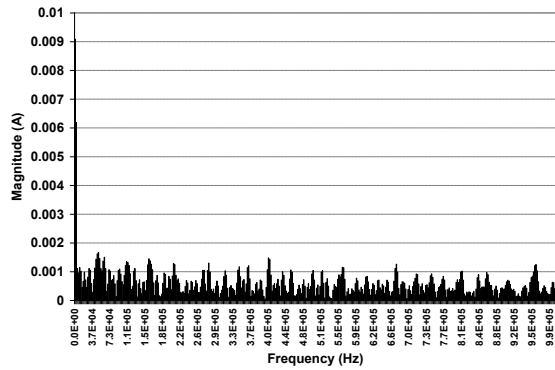

(d) Long range of frequency response

Figure 10. Second sample current waveform result for the first scenario of pulse burden circuit


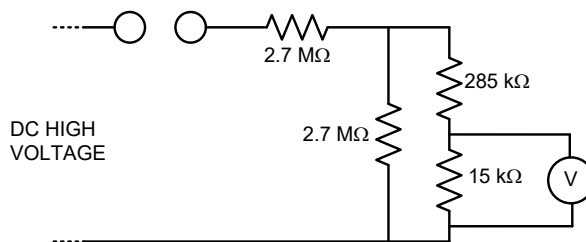



Figure 11. Second scenario of pulse burden as long pure resistive circuit

Figure 11 shows the second scenario of pulse burden circuits. In this circuit, it was pure resistive burden that parallel an  $2.7\text{ M}\Omega$  and  $300\text{ k}\Omega$  resistors, and in series with resistor of  $2.7\text{ M}\Omega$ .


Figure 12 shows the first sample current waveform of measurement result for the second scenario of pulse burden circuit. Figure 12(a) is the first single waveform of discharge pulse. In this waveform, the discharge pulse was occurred in time of around  $1\text{ }\mu\text{s}$ , and the specific discharge wave would cease in time of around  $2\text{ }\mu\text{s}$ . Figure 12(b) is the multiple waveform of discharge pulse. In this waveform, the discharge pulses were occurred in time of  $30, 54, 74, 92$  and  $111\text{ }\mu\text{s}$ , after the first pulse. The average different time among pulses was  $20\text{ }\mu\text{s}$ . Figure 12(c) is the short range of frequency response. The magnitude would increase locally in frequency of  $26855, 36621$  and  $53711\text{ Hz}$ , and Figure 12(d) is the long range one. The magnitudes of discharge current would decrease slightly as the frequency increased.

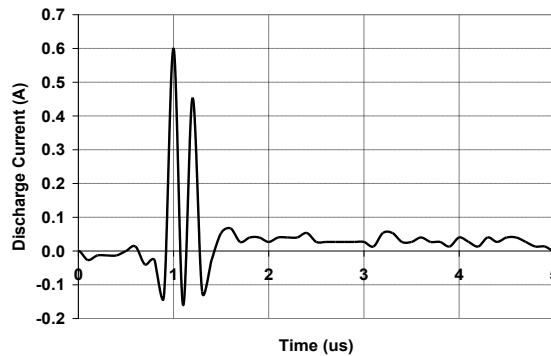


(a) First single waveform

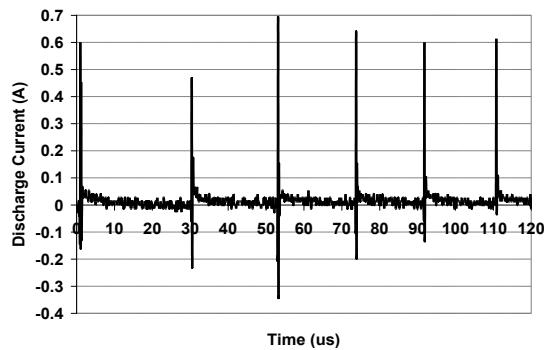

(b) Multiple waveform

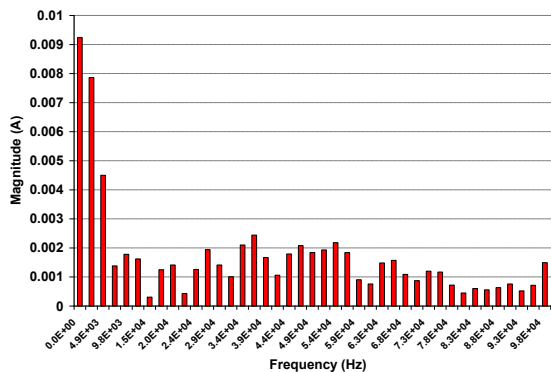


(c) Short range of frequency response

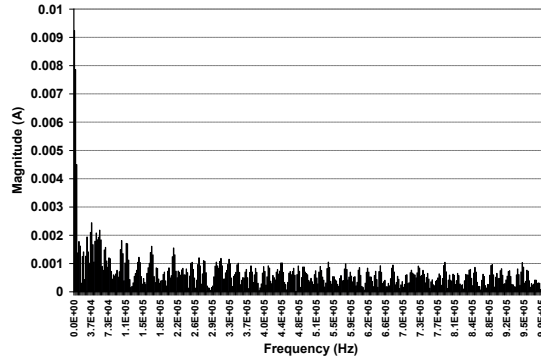


(d) Long range of frequency response

Figure 12. First sample current waveform result for the second scenario of pulse burden circuit


Figure 13 shows the second sample current waveform of measurement result for the second scenario of pulse burden circuit. Figure 13(a) is the first single waveform of discharge pulse. In this waveform, the discharge pulse was occurred in time of around 1  $\mu$ s, and the specific discharge wave would cease in time of around 2  $\mu$ s. Figure 13(b) is the multiple waveform of discharge pulse. In this waveform, the discharge pulses were occurred in time of 27.5, 53, 73, 94 and 112  $\mu$ s, after the first pulse. The average different time among pulses was 22.24  $\mu$ s. Figure 13(c) is the short range of frequency response. The magnitude would increase locally in frequency of 26855, 36621 and 46387 Hz, and Figure 13(d) is the long range one, where the magnitudes of discharge current would decrease slightly as the frequency increased.

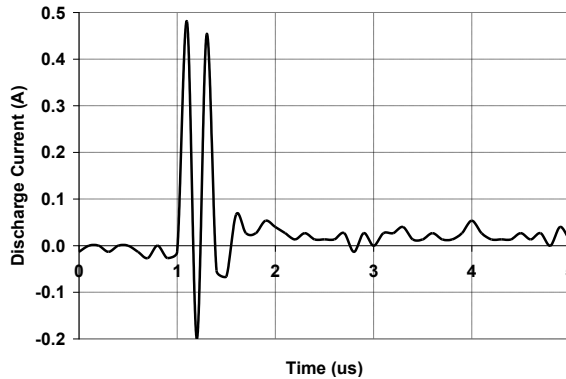


(a) First single waveform

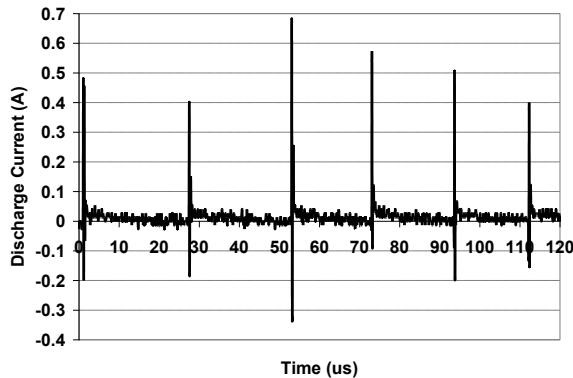

(b) Multiple waveform

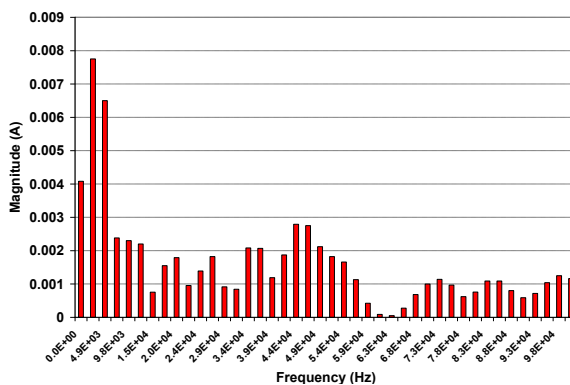

(c) Short range of frequency response

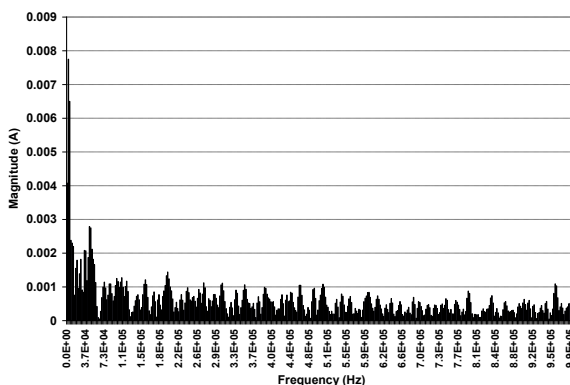

(d) Long range of frequency response

Figure 13. Second sample current waveform result for the second scenario of pulse burden circuit

Figure 14 shows the third scenario of pulse burden circuits. In this circuit, it was pure  $2.7\text{ M}\Omega$  resistive burden that series with  $300\text{ k}\Omega$  resistor and series  $15 \times 10\text{ }\mu\text{F}$  in parallel. Those component were parallel connection with the resistor of  $2.7\text{ M}\Omega$ .


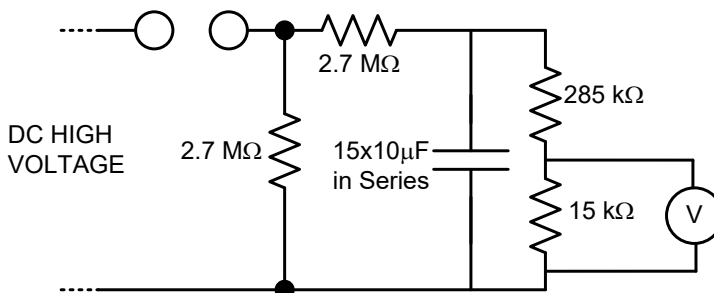



Figure 14. Third scenario of pulse burden as short capacitive-resistive circuit

Figure 15 shows the first sample current waveform of measurement result for the third scenario of pulse burden circuit. Figure 15(a) is the first single waveform of discharge pulse. In this waveform, the discharge pulse was occurred in time of around  $1\text{ }\mu\text{s}$ , and the specific discharge wave would cease in time of around  $2\text{ }\mu\text{s}$ . Figure 15(b) is the multiple waveform of discharge pulse. In this waveform, the discharge pulses were occurred in time of 27.5, 53, 73,


94 and 112  $\mu\text{s}$ , after the first pulse. The average different time among pulses was 22.24  $\mu\text{s}$ . Figure 15(c) is the short range of frequency response. The magnitude would increase locally in frequency of 61035 Hz, and Figure 15(d) shows the long range one, where the magnitudes of discharge current would decrease slightly as the frequency increased.

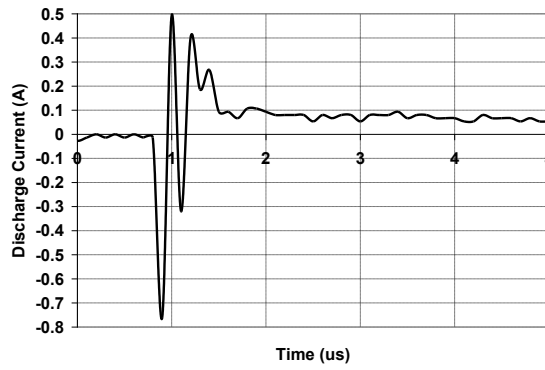


(a) First single waveform

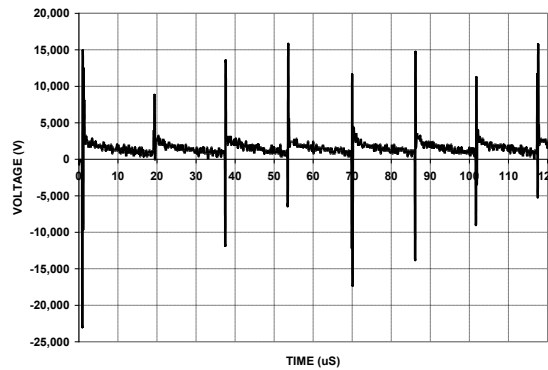

(b) Multiple waveform

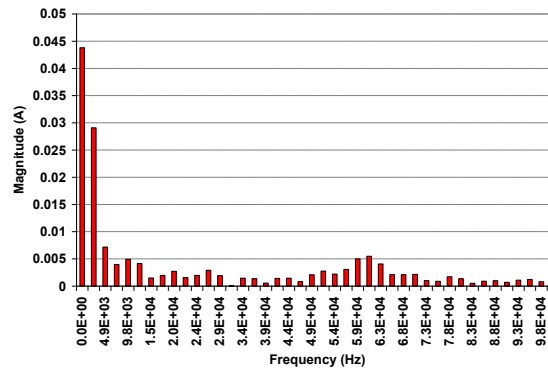


(c) Short range of frequency response

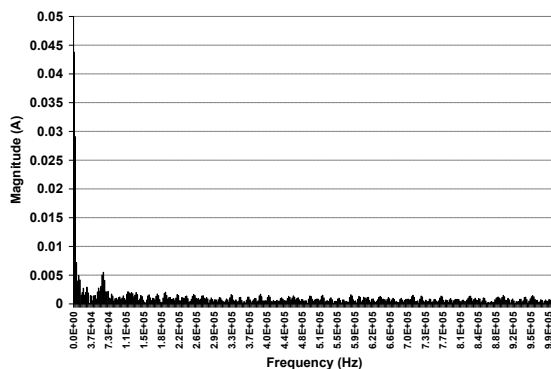


(d) Long range of frequency response

Figure 15. First sample current waveform result for the third scenario of pulse burden circuit

Figure 16 shows the second sample current waveform of measurement result for the third scenario of pulse burden circuit. Figure 16(a) is the first single waveform of discharge pulse. In this waveform, the discharge pulse was occurred in time of around  $1 \mu\text{s}$ , and the specific discharge wave would cease in time of around  $2 \mu\text{s}$ . Figure 16(b) is the multiple waveform of discharge pulse. In this waveform, the discharge pulses were occurred in time of 21, 43.6, 61, 81 and  $107.6 \mu\text{s}$ , after the first pulse. The average different time among pulses was  $21.32 \mu\text{s}$ . Figure 16(c) is the short range of frequency response. The magnitude would increase locally in frequency of 36621 and 48828 Hz, and Figure 16(d) is the long range, that similar to the previous one.

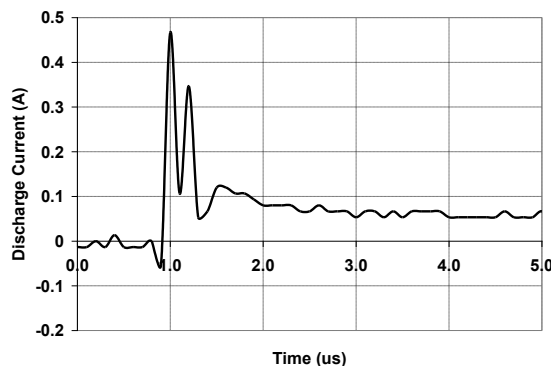


(a) First single waveform

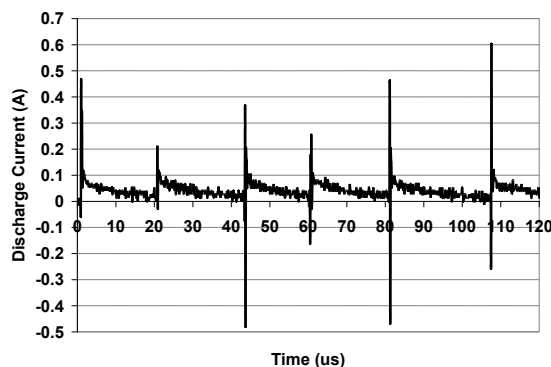


(b) Multiple waveform



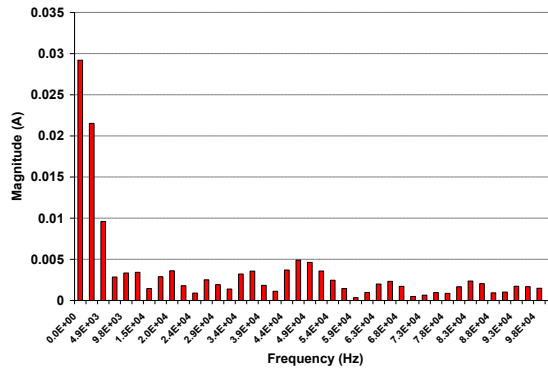

(c) Short range of frequency response

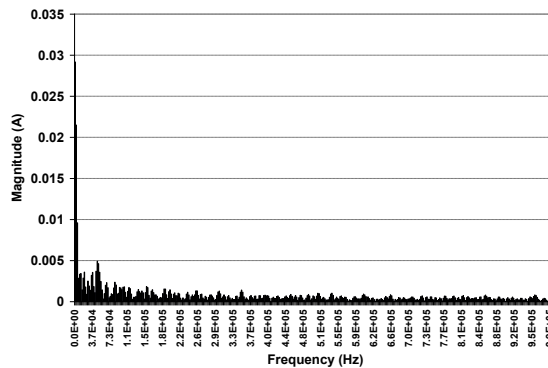

(d) Long range of frequency response

Figure 16. Second sample current waveform result for the third scenario of pulse burden circuit

Figure 17 shows the fourth scenario of pulse burden circuit. In this circuit, it was pure 2.7 MΩ resistive burden that series with 300 kΩ resistor that shunted by 15x10 μF in parallel.


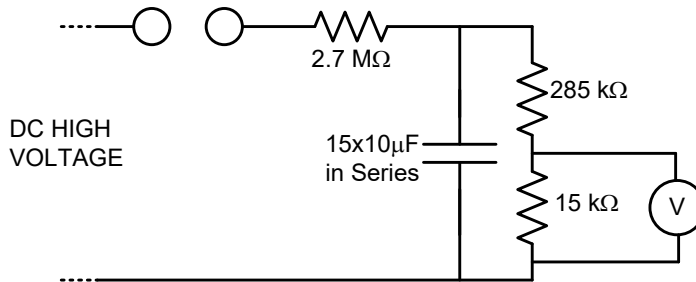



Figure 17. Fourth scenario of pulse burden as long capacitive-resistive circuit

Figure 18 shows the first sample current waveform of measurement result for the fourth scenario of pulse burden circuit. Figure 18(a) shows the first single waveform of discharge pulse. In this waveform, the discharge pulse was occurred in time of around 1 μs, and the specific discharge wave would cease in time of around 2 μs. Figure 18(b) shows the multiple waveform of discharge pulse. In this waveform, the discharge pulses were occurred in time of 0.9, 21.1, 39.3, 56.1, 72.3, 89.9, 104.3 and 118.3 μs, after the first pulse. Nevertheless, almost pulses were negative values. The average different time among pulses was 16.8 μs. Figure 18(c) is the short range of frequency response. The magnitude would increase locally in frequency of


26855 Hz, and Figure 18(d) is the long range one, where the current magnitudes remained relatively high.

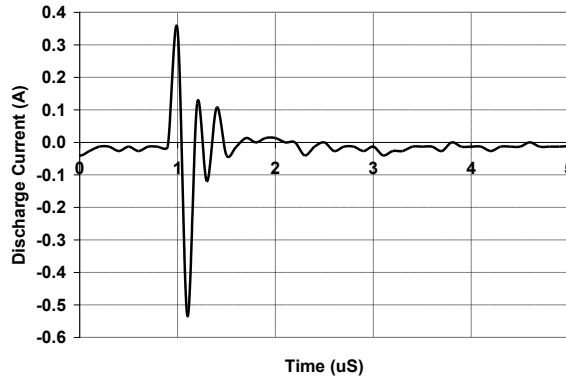


(a) First single waveform

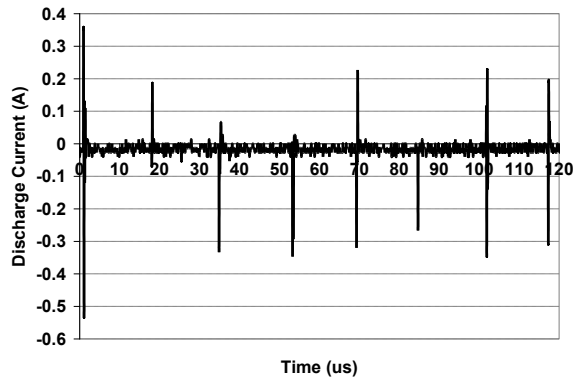

(b) Multiple waveform

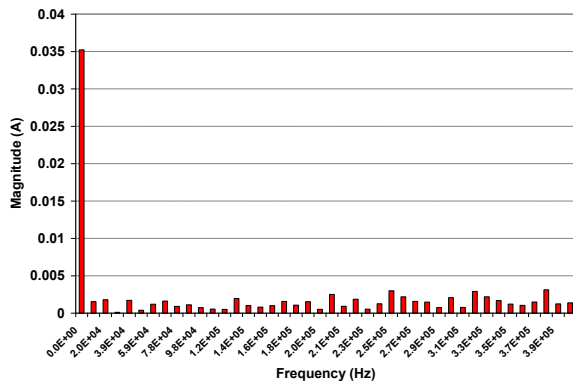


(c) Short range of frequency response

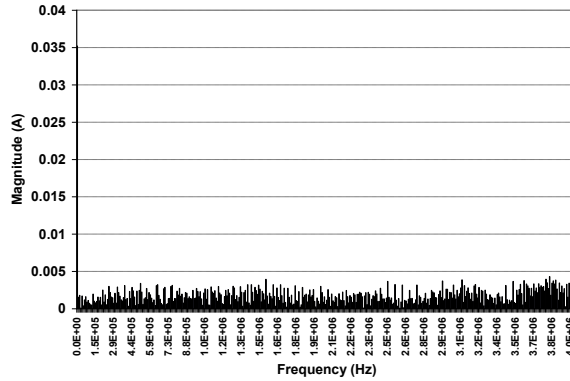


(d) Long range of frequency response

Figure 18. First sample current waveform result for the fourth scenario of pulse burden circuit


Figure 19 shows the second sample current waveform of measurement result for the fourth scenario of pulse burden circuit. Figure 19(a) is the first single waveform of discharge pulse. In this waveform, the discharge pulse was occurred in time of around  $0.75 \mu\text{s}$ , and the specific discharge wave would cease in time of around  $1.5 \mu\text{s}$ . Figure 19(b) is the multiple waveform of discharge pulse. In this waveform, the discharge pulses were occurred in time of  $0.9, 20.7, 40.5, 59.5, 74.9, 89.7, 105.3$  and  $118.3 \mu\text{s}$ , after the first pulse. Nevertheless, almost pulses were negative values. The average different time among pulses was  $16.8 \mu\text{s}$ . Figure 19(c) is the short range of frequency response. The magnitude would increase locally in frequency of  $48828 \text{ Hz}$ , and Figure 19(d) is the long range one, where the current magnitudes remained relatively high.

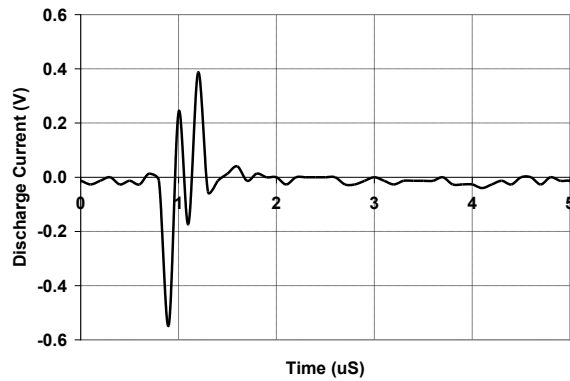


(a) First single waveform

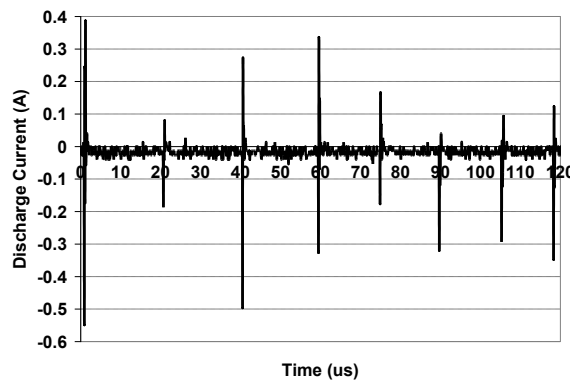

(b) Multiple waveform

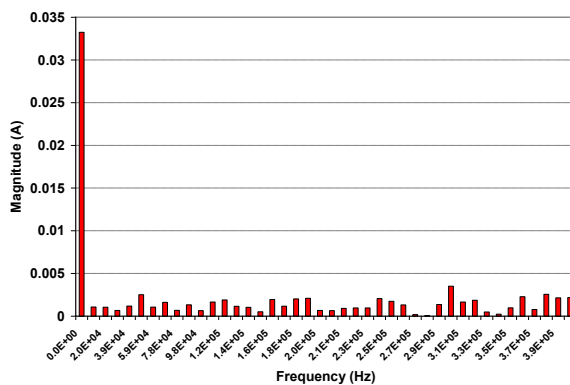

(c) Short range of frequency response

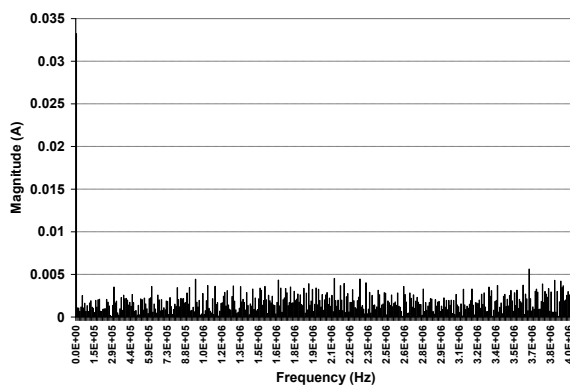

(d) Long range of frequency response

Figure 19. Second sample current waveform result for the fourth scenario of pulse burden circuit

Table 1. Time of discharge and frequency response due to some circuit scenarios

Scenario	Impulse burdens	Times of discharge (μs)	Averages different time of discharge (μs)	Frequencies of increasing magnitude locally (Hz)
1	Short pure resistive circuit	31, 51, 67, 86, 101, 116	17	34180, 43945, 61035
		26, 45, 66, 83, 98, 111	17	31738, 48828, 61035
2	Long pure resistive circuit	30, 54, 74, 92, 111	20	26855, 36621, 53711
		27.5, 53, 73, 94, 112	22.24	26855, 36621, 46387
3	Short resistive-capacitive circuit	27.5, 53, 73, 94, 112	22.24	61035
		21, 43.6, 61, 81, 107.6	21.32	36621, 48828
4	Short resistive-capacitive circuit	0.9, 21.1, 39.3, 56.1, 72.3, 89.9, 104.3, 118.3	16.8	26855
		0.9, 20.7, 40.5, 59.5, 74.9, 89.7, 105.3, 118.3	16.8	48828

Based on some discharge waveforms of testing results, it is observed that the waveforms with the pure resistive burdens would trend to be symmetrical to almost on positive parts. On

the other hand, the waveforms with the resistive and capacitive dominated burdens would be shorter, i.e. around 16.8  $\mu\text{s}$ , than those resistive dominated burdens, i.e. around 17  $\mu\text{s}$  – 22.24  $\mu\text{s}$  in average. The wave frequency response of discharge on the capacitive dominated burdens would be more declivous than those on the resistive dominated burdens. The latter characteristics are indicated by the specific capacitive dominated property. Table 1 lists the tabulation of the time of discharge and frequency response due to some circuit scenarios. Based on the table, the dominated capacitive existence made the repetitive discharge would be shorter than those the dominated resistive existence. The capacitive property that store charge was expected as cause the latter characteristics.

#### 4. Conclusion

Almost all of the first discharge were occurred in around from 1  $\mu\text{s}$  to 2  $\mu\text{s}$ . The waveforms with the pure resistive burdens would trend to be symmetrical to almost on positive parts. On the other hand, the waveforms with the resistive and capacitive dominated burdens would be shorter than those resistive dominated burdens. The wave frequency response of discharge on the capacitive dominated burdens would more declivous than those on the resistive dominated burdens. The latter characteristics are indicated by the specific capacitive dominated property. The dominated capacitive existence made the repetitive discharge would be shorter than those the dominated resistive existence. The capacitive property that store charge was expected as cause the latter characteristics.

#### 5. Acknowledgments

We would like to express the deepest appreciation to The Institute for Research and Community Service, National Institute of Technology (ITENAS), which has supported the funding in the research.

#### 6. References

- [1]. Wadhwa,C.L., “High Voltage Engineering (Second Edition)”, *New Age International (P) Limited, Publishers*, 2007, ISBN: 978-81-224-2323-5, pp.81-104.
- [2]. Lucas, J.R., “High Voltage Engineering, Department of Electrical Engineering”, *University of Moratuwa, Sri Lanka, Revised Edition*, 2001, pp.8-147.
- [3]. Kuffel, E., Zaengle, W.S., Kuffel, J., “High Voltage Engineering Fundamentals”, *Newnes, Butterworth-Heinemann*, 2000, ISBN: 7506-3634-3, pp.48-75.
- [4]. Naidu, MS., Kamaraju, V., “High Voltage Engineering”, Second Edition, *McGraw-Hill*, 1996, ISBN: 1996, ISBN: 0-07-462286-2, pp.129-150.
- [5]. Edirisinghe, M., “Nonlinear Load and RLC Pulse Shaping Surge Generator Models in Simulation Environment”, *International Letters of Chemistry, Physics and Astronomy*, Vol. 36(2014), SciPress Ltd, Switzerland, pp.334-347.
- [6]. Schon, K., “High Impulse Voltage and Current Measurement Techniques”, *Springer International Publishing, Switzerland* 2013, ISBN: 978-3-319-00377-1, pp.5-30.
- [7]. Holtzhausen JP., Vosloo, WL., “High Voltage Engineering”, *Practice and Theory, Draft Version of Book*, ISBN: 978-0-620-3767-7, pp.86-91.
- [8]. Ramleth Sheeba, Madhavan Jayaraju, Thangal Kunju Nediyazhikam Shanavas, “Simulation of Impulse Voltage Generator and Impulse Testing of Insulator using MATLAB Simulink”, ISSN 1 746-7233, *World Journal of Modelling and Simulation, England, UK*, Vol. 8 (2012) No. 4, pp. 302-309.
- [9]. Steven E. Meiners, J. R. Boston, H. K. Kim, R. G. Colclaser, “An Impulse Generator Simulation Circuit”, *Thesis at Electrical Engineering*, University of Pittsburgh, November 25, 2002.
- [10]. Y Choyal, Lalit Gupta, Preeti Vyas, Prasad Deshpande, Anamika Chaturvedi, K C Mittal dan K P Maheshwari, “Development of a 300-kV Marx generator and its application to drive a relativistic electron beam”, *Sadhana* Vol. 30, Part 6, December 2005, pp. 757–764, India.

- [11]. Muhammad Saufi Kamarudin, Erwan Sulaiman, Md Zarafi Ahmad, Shamsul Aizam Zulkifli and Ainul Faiza Othman, "Impulse Generator and Lightning Characteristics Simulation using Orcad PSpice Software", *Proceedings of EnCon2008, 2nd Engineering Conference on Sustainable Engineering Infrastructures Development & Management*, December 18 -19, 2008, Kuching, Sarawak, Malaysia.
- [12]. Takayoshi Nakata, Yoshiyuki Ishihara dan Tadataka Moriyasu, "Calculation of Circuit Constants for Impulse Voltage Generator by Means of Computer", *Memoirs of The School of Engineering*, Okayama University, Vol. 1, No.1, March, 1966.
- [13]. Jari Hallstro, "A Calculable Impulse Voltage Calibrator, Acta Polytechnica Scandinavia", Electrical Engineering Series No. 109, Espoo 2002, 107, *Finnish Academies of Technology*, Finland, 2002, ISBN: 951-22-6174-X, pp.60-70.
- [14]. Yeong-Jer Chen, B.S.E.E., Andreas Neuber, John Mankowski, "Compact Repetitive Marx Generator and HPM Generation with the Vircator", *Electrical Engineering Graduate*, Faculty of Texas Tech University, December, 2005.
- [15]. A.A. Hueit, E. Bautista, L.J. Villegast Anij M. Villagian, "High voltage pulse generators and spark gap for gaseous discharge control", *Instrumentación Revista Mexicana de Física* 41, No. 3, 1995, pp.08-18.
- [16]. Ju-Hong Eom, Sung-Chul Cho† and Tae-Hyung Lee\*, "Parameters Optimization of Impulse Generator Circuit for Generating First Short Stroke Lightning Current Waveform", *J Electr Eng Technol* Vol. 9, No. 1: 286-292, 2014.
- [17]. Zhu, Y., Zuegel, J.D., Marciante, J.R., Wu, H., "Distributed Waveform Generator: A New Circuit Technique for Ultra-Wideband Pulse Generation, Shaping and Modulation", *IEEE Journal of Solid-State Circuits*, Vol. 44, No. 3, March 2009, pp.808-823.
- [18]. Waluyo, Syahrial, Sigit Nugraha, Yudhi Permana JR, "Miniature Prototype Design and Implementation of Modified Multiplier Circuit DC High Voltage Generator", *International Journal of Electrical Engineering & Technology (IJEET)*, International Association for Engineering and Management Education (IAEME), Volume 6, Issue 1, January (2015), pp. 01-12.



**Waluyo** was born in Magelang, Indonesia in 1969. He received B.Eng., M.Eng., and Doctor Degrees in electrical engineering from Bandung Insitute of Technology (ITB), Indonesia, in 1994, 2002 and 2010 respectively. Since 2003, he is a Lecturer at Department of Electrical Engineering, National Institute of Technology (Itenas) Bandung, Indonesia. His research interests include of high voltage phenomena. He received Best Lecturer in Kopertis IV in 2013.



**Syahrial** was born in Lirik, Sumatera, Indonesia in 1969. He received B.Eng., Degree in electrical engineering from National Insitute of Technology (Itenas) Bandung, Indonesia, in 2000, and M.Eng. Degree in electrical engineering from Bandung Insitute of Technology (ITB), Indonesia, in 2004. Since 2005, he is a Lecturer at Department of Electrical Engineering, National Institute of Technology (Itenas) Bandung, Indonesia. His research interests include of electrical machines.



**Sigit Nugraha** was born in Subang, West Java, Indonesia. He is currently senior university student and doing final project at The Department of Electrical Engineering, National Institute of Technology (Itenas) Bandung, Indonesia.



**Yudhi Permana JR** was born in Padang, West Sumatera, Indonesia. He is currently senior university student and doing final project at The Department of Electrical Engineering, National Institute of Technology (Itenas) Bandung, Indonesia.